


# INSTRUCTION MANUAL

## GNExCP6A-BG Break glass Manual Call Point

### For use in Flammable Gas and Dust Atmospheres

#### GNExCP6A-BG Manual Call Point – Break Glass For use in Flammable Gas and Combustible Dust Atmospheres.

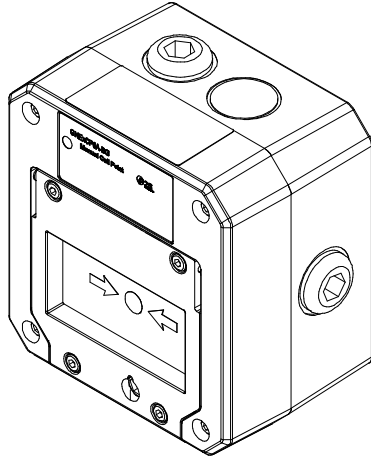

#### 1) Introduction

The GNExCP6A-BG is a break glass manual call point which is certified to the European and International Gas and Dust standards. The unit meets the requirements of the ATEX directive 2014/34/EU, IECEx and UKEX schemes.

The call point can be used in hazardous areas where potentially flammable gas and dust atmospheres may be present.

All units have no monitoring resistors, diodes or zener diodes and are not fitted with an LED indicator.

The units are Group II, EPL (equipment protection level) Gb. The equipment is certified 'Ex db eb IIC T6 Gb' and as such may be used in Zones 1 and 2 with flammable gases and vapours with apparatus groups IIA, IIB & IIC and temperature classes T1, T2, T3, T4, T5 and T6.

These units are also Group III, EPL Db. The equipment is certified 'Ex tb IIIC T75°C Db' and as such may be used in Zones 21 and 22 for combustible dusts groups IIIA, IIIB & IIIC.

#### 2) Ratings & Markings

All units have a rating label, which carries the following important information:-

Unit Type No.:  
GNExCP6A-BG Manual Call Point

Input Voltage:  
AC voltage 250V Max Current 5.0A Max  
DC voltage 250V Max Current 0.25A Max Resistive load : 0.03A Max Inductive load  
DC voltage 125V Max Current 0.5A Max Resistive load : 0.03A Max Inductive load  
DC voltage 75V Max Current 0.75A Max  
DC voltage 50V Max Current 1.0A Max  
DC voltage 30V Max Current 5.0A Max Resistive Load; Inductive Load 3.0A Max  
DC voltage 12V Max Current 5.0A Max


Code:

Ex db eb IIC T6 Gb  
Ex tb IIIC T75 °C Db  
IP66  
-40°C <= Ta <= +70°C

Certificate No.:  
SIRA 09ATEX3286X  
IECEx SIR 09.0121X  
CSAE 21UKEX3556X

Epsilon x:  II 2GD

CE Marking  
Notified  
Body No.  2813

UKCA Marking  
Notified Body No.  0518

Year/Serial No. i.e. 20/1CP6ABG000001

**WARNING - DO NOT OPEN WHEN AN  
EXPLOSIVE ATMOSPHERE MAY BE PRESENT  
ELECTROSTATIC HAZARD – CLEAN ONLY  
WITH A DAMP CLOTH**

#### 3) Type Approval Standards

The call point has an EC Type examination certificate issued by SIRA and have been approved to the following standards:-

EN60079-0:2018 / IEC60079-0:2017  
EN60079-1:2014 / IEC60079-1:2014  
EN60079-7:2015 / IEC60079-7:2017

EN60079-18:2015 / IEC60079-18:2014  
EN60079-31:2014 / IEC60079-31:2013

The equipment is certified for use in ambient temperatures in the range -40°C to +70°C and shall not be used outside this range.

#### 4) Installation Requirements

Installation of this equipment shall only be carried out by suitably trained personnel in accordance with the applicable code of practice e.g. IEC 60079-14/EN 60079-14

Repair of this equipment shall only be carried out by the manufacturer or in accordance with the applicable code of practice e.g. IEC 60079-19/EN 60079-19.

Refer to certificates SIRA 09ATEX3286X, IECEx SIR 09.0121X and CSAE 21UKEX3556X for special conditions of safe use.

The certification of this equipment relies on the following materials used in its construction:

Enclosure: GRP - Glass Reinforced Polyester

Through enclosure mechanism: Plastic Nylon Zytel Injection Moulded

Sealing of enclosure and mechanism: O-ring Acrylonitrile-Butadiene Rubber

If the equipment is likely to come into contact with aggressive substances, then it is the responsibility of the user to take suitable precautions that prevent it from being adversely affected, thus ensuring that the type of protection is not compromised.

"Aggressive substances" - e.g. acidic liquids, gases or solvents that may affect polymeric materials.


"Suitable precautions" - e.g. regular checks as part of routine inspections or establishing from the material's data sheet that it is resistant to specific chemicals.

Under extreme conditions the unit may generate an ignition-capable level of electrostatic charges. The unit must not be installed in a location where it may be subjected to external conditions (such as high pressure steam) which may cause a build-up of electrostatic charges on non-conducting surfaces.

Cleaning of the unit must only be carried out with a damp cloth.


#### 5) Call Point Location and Mounting

The location of the call point should enable ease of access for operation and testing. The unit should be mounted using the 4 off fixing holes which will accept up to M4 sized fixings.

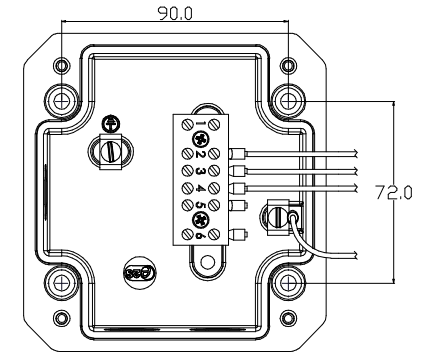

View of base unit showing fixing centres (in mm).


To gain access to the mounting holes in the base the front cover must be removed. This is achieved by removing the 4 off M4 cap head bolts holding on the cover.

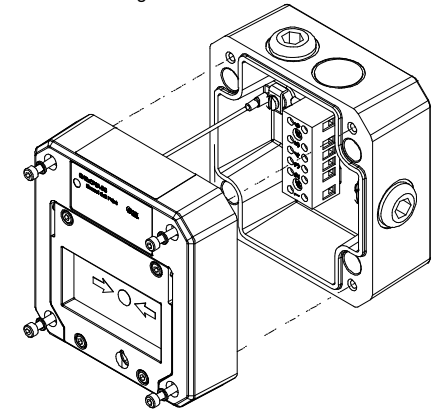

Once the screws are removed the cover will hang down out of the way to gain access to the Ex e terminal block, the internal earth terminal and mounting hole recesses.

### 6) Earthing

The unit has an internal earth terminal. It is recommended that a cable crimp lug is used on the earth wires. The internal earth wire is placed under an earth clamp which will stop the cable twisting. This is secured by an M4 screw and spring washer.

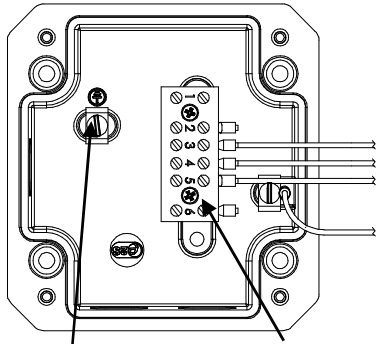

Internal Earth terminal      Ex e terminal block

Note: Depending on options chosen an 8-Way DIN Rail or 6-Way terminal block may be selected.

### 7) Cable connections

There are 3 off cable entries for M20x1.5 Ex e approved cable glands or stopping plugs with a minimum ingress protection of IP66.

The unit can be wired in a number of different ways depending whether normally open or normally closed contacts are required. See wiring schematic D154-06-001 for wiring options.


When wiring to Increased Safety terminal enclosures, you are only permitted to connect one wire into each way on the terminal block, unless a pair of wires are crimped into a suitable ferrule. For the six-way terminal block wire sizes allowable are 0.5mm<sup>2</sup> to 4.0mm<sup>2</sup>. For the 8-way DIN rail wire sizes allowable are 0.5mm<sup>2</sup> to 2.5mm<sup>2</sup>

Leads connected to the terminals shall be insulated for the appropriate voltage and this insulation shall extend to within 1mm of the metal of the terminal throat. They shall only be installed and wired with cable in an ambient temperature of -10°C to +80°C

All terminal screws, used or unused, shall be tightened down to between 0.5 Nm and 0.7 Nm.


### 8) Testing unit operation

The break glass unit can be tested without the need to break/replace the frangible glass element. A test key is used to mechanically drop the glass down activating the switch.



The test key is inserted in the test cam and rotated clockwise by an angle of 60° the glass element will visibly drop down in the viewable window. The call point switch will now change over its contacts to operate the alarm.

Once testing is complete the unit needs to be reset, the test key is rotated back anticlockwise by an angle of 60° back to its original position. The glass element should now raise up so it is level again in the viewable window.

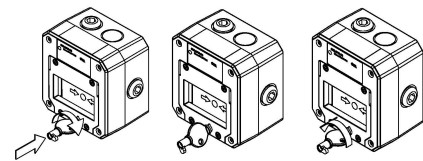


1. Insert test Key rotate clockwise 60°
2. Hold in position during test
3. Rotate back anticlockwise to reset


### 9) Replacement of glass element

If the break glass unit has been operated the broken glass element can be quickly replaced.


The break glass cover plate is removed by unscrewing the 4 off M4 cap head screws attaching it.

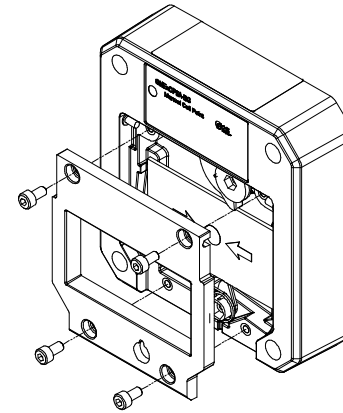

Once the cover is removed the broken glass will be free to be removed, clean out any other fragments of glass carefully.

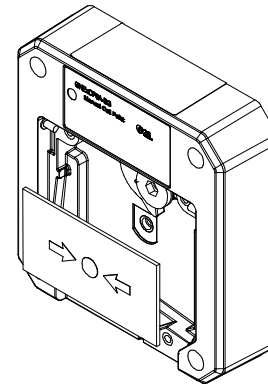

To fit the new glass element rotate the top cam clockwise by an angle of 50° (use a 6mm Allen key) this will then allow the glass to fit back into the pocket it sits in, resting on the pivot point and test cam, release the top cam to rest on the top of the glass element.

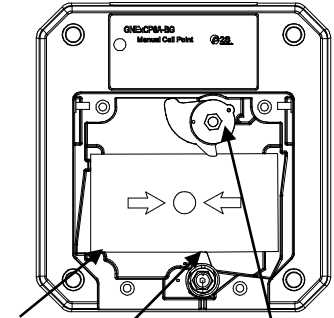

Pivot point    Test Cam    Top Cam (rotate)

Replace the cover plate and tighten the 4 off M4 cap head screws.

Ensure the glass element is free to move under the cover plate. This can be done by running through the units test operation. See section 8 of this instruction manual.

### 10) SIL 2 Reliability Data

Reliability and Functional safety IEC/EN61508 which has been assessed and is considered suitable for use in low demand safety function:

- Random Hardware Failures and Systematic Failures (route 2H)
- As an unvoted item (i.e. hardware fault tolerance of 0) at SIL 2

The product was assessed against failure modes:



- Failure to close a contact when the call point is struck with specified force
- Failure to open a contact when the call point is struck with specified force
- Spurious output despite no input

| Integrity in respect of failure to close | SIL 2                   |
|--|-------------------------|
| Total Failure rate                       | 0.133 pmh               |
| "hazardous" failure rate (revealed)      | 0 pmh                   |
| "hazardous" failure rate (unrevealed)    | 0.1 pmh                 |
| "safe" failure rate (revealed)           | 0.033 pmh               |
| "safe" failure rate (unrevealed)         | 0                       |
| Diagnostic Coverage                      | 99%                     |
| System type                              | A                       |
| Hardware Fault Tolerance                 | 0                       |
| Safe Failure Fraction                    | >99%                    |
| PFD (hazardous failure)                  | 1.25 x 10 <sup>-3</sup> |
| Proof Test Interval                      | Up to 1 year            |

|                      |                  |                    |                  |
|----------------------|------------------|--------------------|------------------|
| <b>SINGLE SWITCH</b> | <b>CONFIG. 1</b> | <b>DUAL SWITCH</b> | <b>CONFIG. 2</b> |
|----------------------|------------------|--------------------|------------------|

SWITCH TYPE [s] [S] Single Switch

SWITCH TYPE [s] [D] Dual Switch

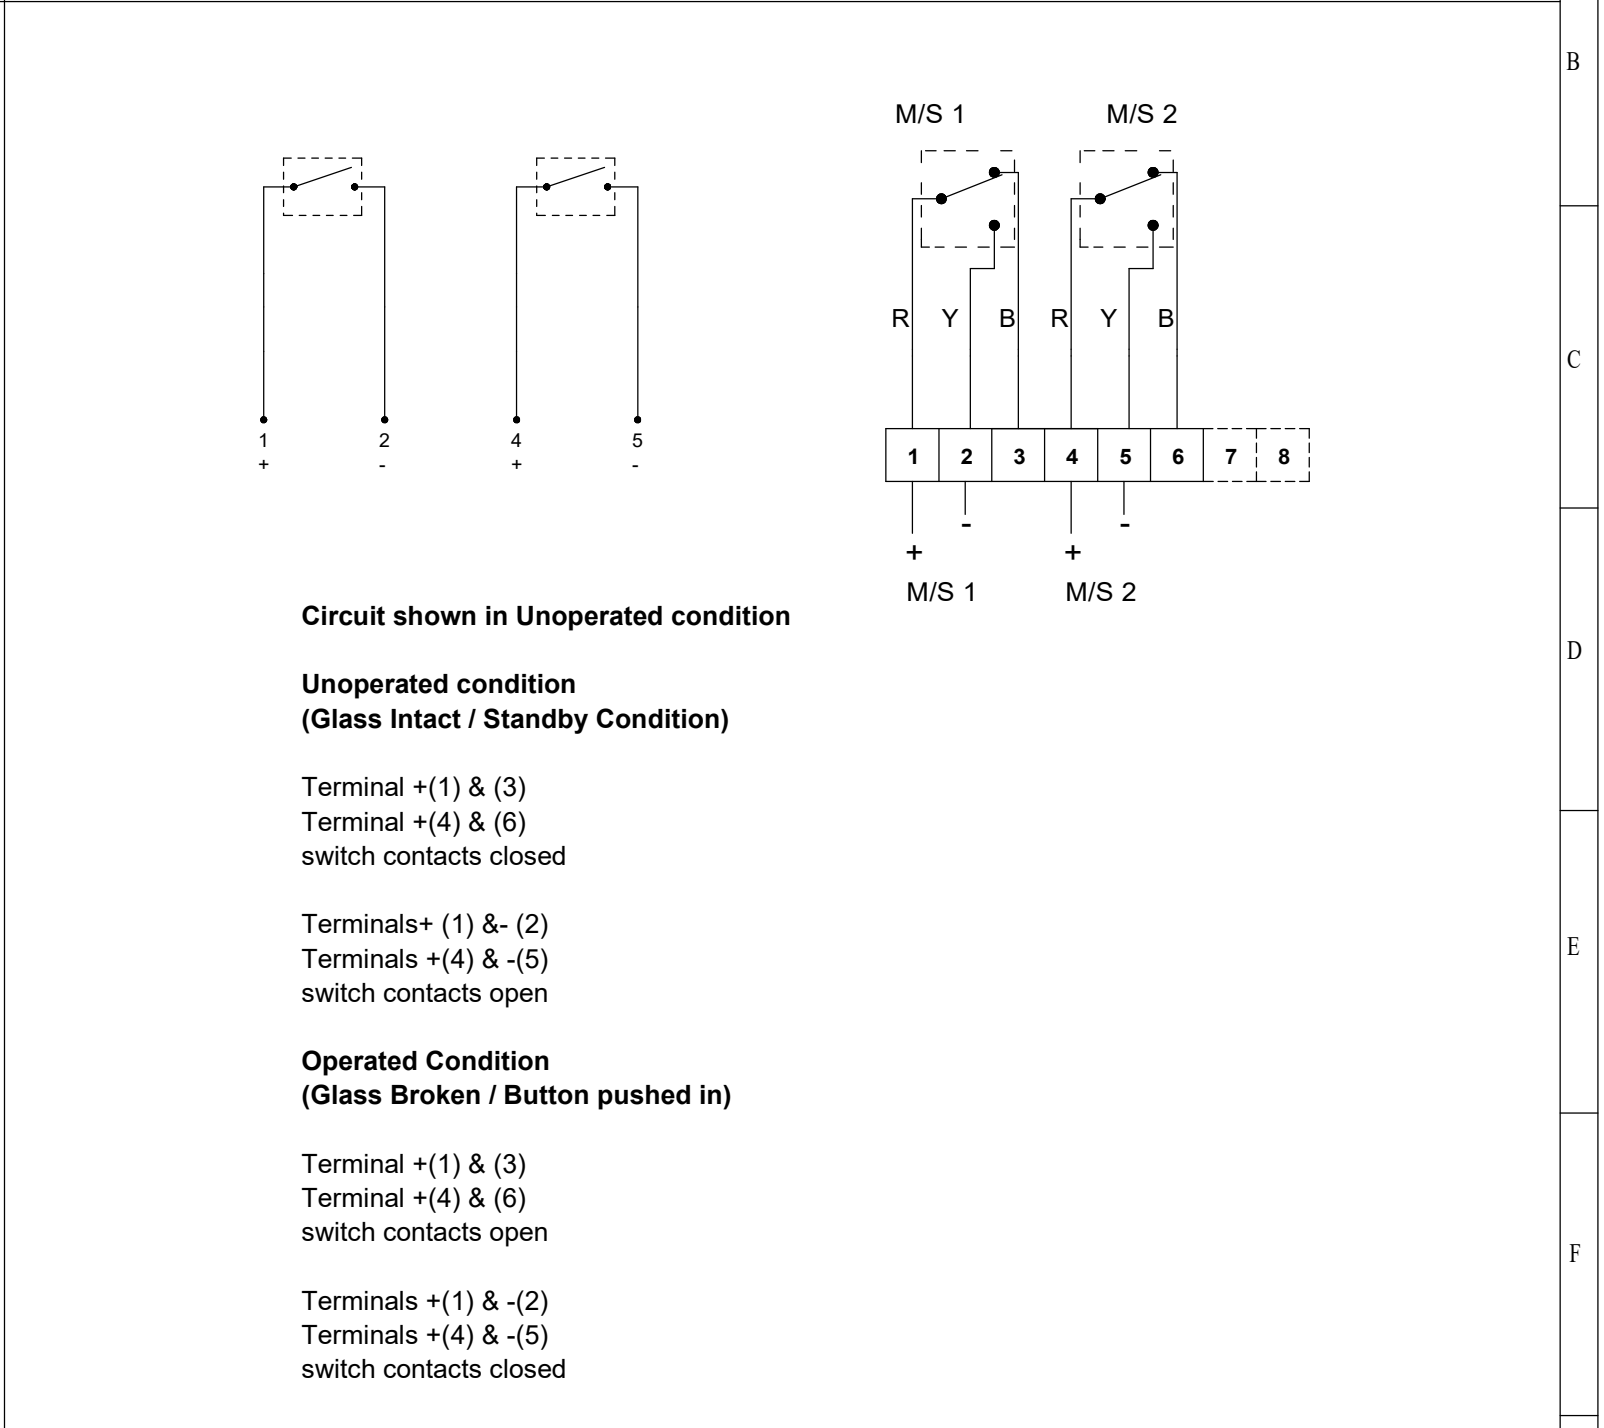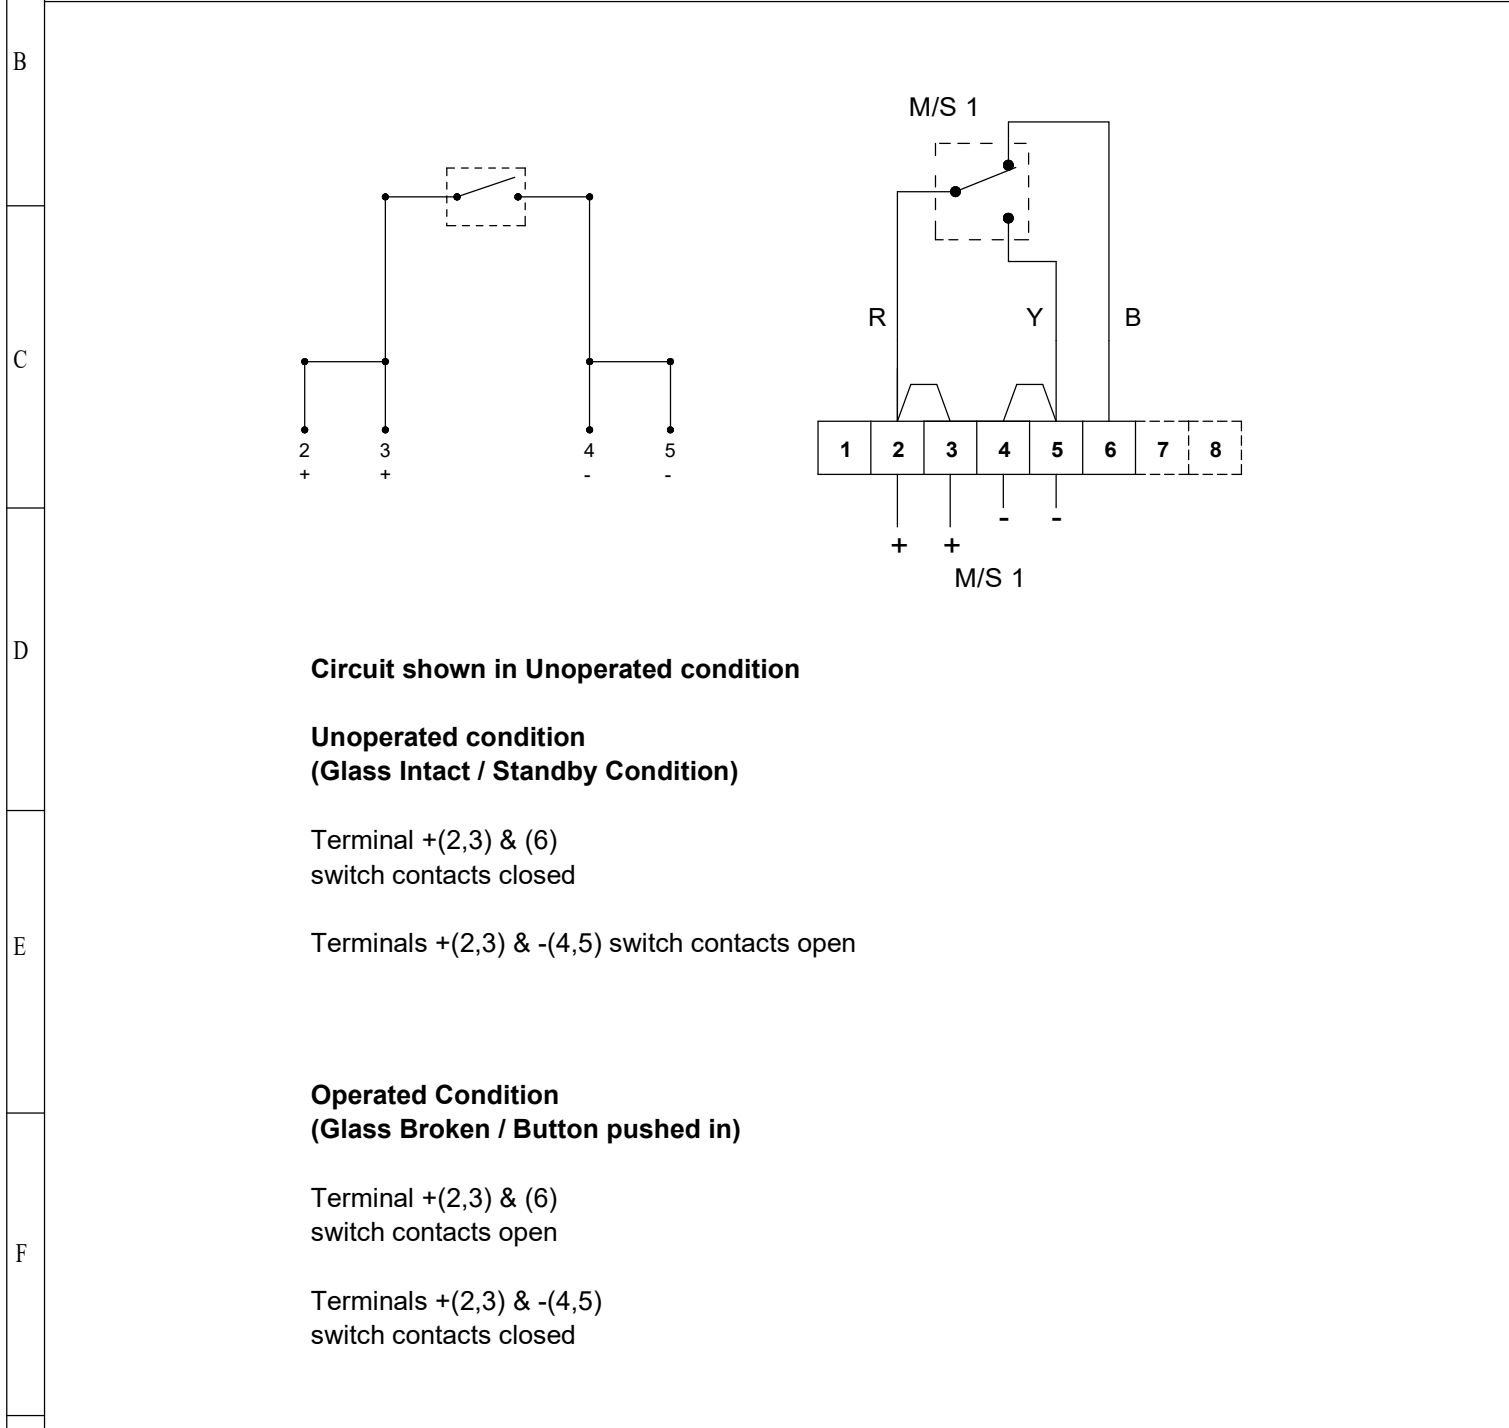

# EU Declaration of Conformity



**Manufacturer:** European Safety Systems Ltd.  
Impress House, Mansell Road, Acton  
London, W3 7QH  
United Kingdom

**Authorised Representative:** E2S Warnsignaltechnik UG  
Charlottenstrasse 45-51  
72764 Reutlingen  
Germany

**Equipment Type:** GNExCP6A-BG, GNExCP6A-PB, GNExCP6A-PT  
GNExCP6B-BG, GNExCP6B-PB, GNExCP6B-PT,  
GNExCP6C-BG, GNExCP6C-PB, GNExCP6C-PT  
GNExCP6D-BG, GNExCP6D-PB, GNExCP6D-PT  
GNExCP6E-BG, GNExCP6E-PB, GNExCP6E-PT

---

## Directive 2014/34/EU: Equipment and Protective Systems for use in Potentially Explosive Atmospheres (ATEX)

|   |   |           |   |           |  |           |  |           |  |           |  |
|---|---|-----------|---|-----------|--|-----------|--|-----------|--|-----------|--|
| Notified Body for EU type Examination (Module B):   | Sira Certification Service<br>Notified Body No.: 2813<br>CSA Group Netherlands B.V, Utrechtseweg 310, 6812 AR, Arnhem, Netherlands  |           |   |           |  |           |  |           |  |           |  |
| EU-type Examination Certificate (Module B):   | Sira 09ATEX3286X  |           |   |           |  |           |  |           |  |           |  |
| Notified Body for Quality Assurance Notification / Conformity to EU-type based on quality assurance of the production process (Module D): | Sira Certification Service<br>Notified Body No.: 2813<br>CSA Group Netherlands B.V, Utrechtseweg 310, 6812 AR, Arnhem, Netherlands  |           |   |           |  |           |  |           |  |           |  |
| Quality Assurance Notification (Module D):  | SIRA 05 ATEX M342   |           |   |           |  |           |  |           |  |           |  |
| Provisions fulfilled by the equipment:  | <table><tr><td>GNExCP6A:</td><td>II 2G Ex db eb IIC T6 Gb (-40°C ≤ Ta ≤ +70°C)<br/>II 2D Ex tb IIIC T75°C Db (-40°C ≤ Ta ≤ +70°C)<br/>or</td></tr><tr><td>GNExCP6B:</td><td>II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +50°C)<br/>II 2D Ex tb IIIC T80°C Db (-40°C ≤ Ta ≤ +50°C)<br/>or</td></tr><tr><td>GNExCP6C:</td><td>II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +65°C)<br/>II 2D Ex tb IIIC T75°C Db (-40°C ≤ Ta ≤ +65°C)<br/>or</td></tr><tr><td>GNExCP6D:</td><td>II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +70°C)<br/>II 2D Ex tb IIIC T80°C Db (-40°C ≤ Ta ≤ +70°C)<br/>or</td></tr><tr><td>GNExCP6E:</td><td>II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +65°C)<br/>II 2D Ex tb IIIC T75°C Db (-40°C ≤ Ta ≤ +65°C)</td></tr></table> | GNExCP6A: | II 2G Ex db eb IIC T6 Gb (-40°C ≤ Ta ≤ +70°C)<br>II 2D Ex tb IIIC T75°C Db (-40°C ≤ Ta ≤ +70°C)<br>or | GNExCP6B: | II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +50°C)<br>II 2D Ex tb IIIC T80°C Db (-40°C ≤ Ta ≤ +50°C)<br>or | GNExCP6C: | II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +65°C)<br>II 2D Ex tb IIIC T75°C Db (-40°C ≤ Ta ≤ +65°C)<br>or | GNExCP6D: | II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +70°C)<br>II 2D Ex tb IIIC T80°C Db (-40°C ≤ Ta ≤ +70°C)<br>or | GNExCP6E: | II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +65°C)<br>II 2D Ex tb IIIC T75°C Db (-40°C ≤ Ta ≤ +65°C) |
| GNExCP6A:   | II 2G Ex db eb IIC T6 Gb (-40°C ≤ Ta ≤ +70°C)<br>II 2D Ex tb IIIC T75°C Db (-40°C ≤ Ta ≤ +70°C)<br>or   |           |   |           |  |           |  |           |  |           |  |
| GNExCP6B:   | II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +50°C)<br>II 2D Ex tb IIIC T80°C Db (-40°C ≤ Ta ≤ +50°C)<br>or  |           |   |           |  |           |  |           |  |           |  |
| GNExCP6C:   | II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +65°C)<br>II 2D Ex tb IIIC T75°C Db (-40°C ≤ Ta ≤ +65°C)<br>or  |           |   |           |  |           |  |           |  |           |  |
| GNExCP6D:   | II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +70°C)<br>II 2D Ex tb IIIC T80°C Db (-40°C ≤ Ta ≤ +70°C)<br>or  |           |   |           |  |           |  |           |  |           |  |
| GNExCP6E:   | II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +65°C)<br>II 2D Ex tb IIIC T75°C Db (-40°C ≤ Ta ≤ +65°C)  |           |   |           |  |           |  |           |  |           |  |
| Standards applied:  | EN IEC 60079-0:2018<br>EN 60079-1:2014<br>EN 60079-7:2015/A1:2108<br>IEC 60079-18:2015/AC:2018<br>EN 60079-31: 2014<br>IP6X Dust Protection to EN60079-0 / EN 60079-31  |           |   |           |  |           |  |           |  |           |  |

## Directive 2014/30/EU: Electromagnetic Compatibility Directive (EMC)

|                    |  |
|--------------------|--|
| Standards applied: | EN 61000-6-1:2007<br>EN 61000-6-2:2005<br>EN 61000-6-3:2007 / A1:2011 / AC: 2012<br>EN 61000-6-4:2007 / A1: 2011 |
|--------------------|--|

# EU Declaration of Conformity



Directive 2011/65/EU: Restriction of the use of certain hazardous substances in electrical and electronic equipment (RoHS)

The product and all the components contained within it are in accordance with the restriction of the use of hazardous substances in electrical and electronic equipment, including amendment by Directive 2015/863/EU.

Regulation (EC) 1907/2006: Registration, Evaluation, Authorisation and Restriction of Chemicals (REACH)

The product and all the components contained within it are free from substances of very high concern.

Other Standards and Regulations

EN 60529:1992+A2:2013 - Degrees of protection provided by enclosures (IP code) – enclosure rated IP66

---

On behalf of European Safety Systems Ltd., I declare that, on the date the equipment accompanied by this declaration is placed on the market, the equipment conforms with all technical and regulatory requirements of the above listed directives, regulations and standards.

This Declaration is issued under the sole responsibility of the manufacturer.

A handwritten signature in black ink, appearing to read 'Martin Streetz', written over a faint, illegible background.

Martin Streetz  
Quality Assurance Manager

Document No.: DC-043\_Issue\_J  
Date and Place of Issue: London, 23/12/2020

Manufacturer: European Safety Systems Ltd.  
Impress House, Mansell Road, Acton  
London, W3 7QH  
United Kingdom

Equipment Type: GNExCP6A-BG, GNExCP6A-PB, GNExCP6A-PT  
GNExCP6B-BG, GNExCP6B-PB, GNExCP6B-PT,  
GNExCP6C-BG, GNExCP6C-PB, GNExCP6C-PT  
GNExCP6D-BG, GNExCP6D-PB, GNExCP6D-PT  
GNExCP6E-BG, GNExCP6E-PB, GNExCP6E-PT

Directive UKSI 2016:1107 (as amended by UKSI 2019:696) – Schedule 3A, Part 1 : Product or Protective System Intended for use in Potentially Explosive Atmospheres (UKCA)

|   |   |           |   |           |  |           |  |           |  |           |  |
|---|---|-----------|---|-----------|--|-----------|--|-----------|--|-----------|--|
| Notified Body for UK type Examination (Module B):   | Sira Certification Service<br>Notified Body No.: 0518<br>Rake Lane, Eccleston, Chester CH4 9JN, UK  |           |   |           |  |           |  |           |  |           |  |
| UK-type Examination Certificate (Module B):   | CSAE 21UKEX3556X  |           |   |           |  |           |  |           |  |           |  |
| Notified Body for Quality Assurance Notification / Conformity to EU-type based on quality assurance of the production process (Module D): | Sira Certification Service<br>Notified Body No.: 0518<br>Rake Lane, Eccleston, Chester CH4 9JN, UK  |           |   |           |  |           |  |           |  |           |  |
| Quality Assurance Notification (Module D):  | CSAE 22UKQAN0046  |           |   |           |  |           |  |           |  |           |  |
| Provisions fulfilled by the equipment:  | <table border="0"> <tr> <td>GNExCP6A:</td> <td>II 2G Ex db eb IIC T6 Gb (-40°C ≤ Ta ≤ +70°C)<br/>II 2D Ex tb IIIC T75°C Db (-40°C ≤ Ta ≤ +70°C)<br/>or</td> </tr> <tr> <td>GNExCP6B:</td> <td>II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +50°C)<br/>II 2D Ex tb IIIC T80°C Db (-40°C ≤ Ta ≤ +50°C)<br/>or</td> </tr> <tr> <td>GNExCP6C:</td> <td>II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +65°C)<br/>II 2D Ex tb IIIC T75°C Db (-40°C ≤ Ta ≤ +65°C)<br/>or</td> </tr> <tr> <td>GNExCP6D:</td> <td>II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +70°C)<br/>II 2D Ex tb IIIC T80°C Db (-40°C ≤ Ta ≤ +70°C)<br/>or</td> </tr> <tr> <td>GNExCP6E:</td> <td>II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +65°C)<br/>II 2D Ex tb IIIC T75°C Db (-40°C ≤ Ta ≤ +65°C)</td> </tr> </table> | GNExCP6A: | II 2G Ex db eb IIC T6 Gb (-40°C ≤ Ta ≤ +70°C)<br>II 2D Ex tb IIIC T75°C Db (-40°C ≤ Ta ≤ +70°C)<br>or | GNExCP6B: | II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +50°C)<br>II 2D Ex tb IIIC T80°C Db (-40°C ≤ Ta ≤ +50°C)<br>or | GNExCP6C: | II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +65°C)<br>II 2D Ex tb IIIC T75°C Db (-40°C ≤ Ta ≤ +65°C)<br>or | GNExCP6D: | II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +70°C)<br>II 2D Ex tb IIIC T80°C Db (-40°C ≤ Ta ≤ +70°C)<br>or | GNExCP6E: | II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +65°C)<br>II 2D Ex tb IIIC T75°C Db (-40°C ≤ Ta ≤ +65°C) |
| GNExCP6A:   | II 2G Ex db eb IIC T6 Gb (-40°C ≤ Ta ≤ +70°C)<br>II 2D Ex tb IIIC T75°C Db (-40°C ≤ Ta ≤ +70°C)<br>or   |           |   |           |  |           |  |           |  |           |  |
| GNExCP6B:   | II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +50°C)<br>II 2D Ex tb IIIC T80°C Db (-40°C ≤ Ta ≤ +50°C)<br>or  |           |   |           |  |           |  |           |  |           |  |
| GNExCP6C:   | II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +65°C)<br>II 2D Ex tb IIIC T75°C Db (-40°C ≤ Ta ≤ +65°C)<br>or  |           |   |           |  |           |  |           |  |           |  |
| GNExCP6D:   | II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +70°C)<br>II 2D Ex tb IIIC T80°C Db (-40°C ≤ Ta ≤ +70°C)<br>or  |           |   |           |  |           |  |           |  |           |  |
| GNExCP6E:   | II 2G Ex db eb mb IIC T4 Gb (-40°C ≤ Ta ≤ +65°C)<br>II 2D Ex tb IIIC T75°C Db (-40°C ≤ Ta ≤ +65°C)  |           |   |           |  |           |  |           |  |           |  |
| Standards applied:  | EN IEC 60079-0:2018<br>EN 60079-1:2014<br>EN 60079-7:2015/A1:2108<br>IEC 60079-18:2015/AC:2018<br>EN 60079-31: 2014<br>IP6X Dust Protection to EN60079-0 / EN 60079-31  |           |   |           |  |           |  |           |  |           |  |

Directive 2014/30/EU: Electromagnetic Compatibility Directive (EMC)

|                    |  |
|--------------------|--|
| Standards applied: | EN 61000-6-1:2007<br>EN 61000-6-2:2005<br>EN 61000-6-3:2007 / A1:2011 / AC: 2012<br>EN 61000-6-4:2007 / A1: 2011 |
|--------------------|--|

Directive 2011/65/EU: Restriction of the use of certain hazardous substances in electrical and electronic equipment (RoHS)

The product and all the components contained within it are in accordance with the restriction of the use of hazardous substances in electrical and electronic equipment, including amendment by Directive 2015/863/EU.

Regulation (EC) 1907/2006: Registration, Evaluation, Authorisation and Restriction of Chemicals (REACH)

The product and all the components contained within it are free from substances of very high concern.



# UKCA Declaration of Conformity



## Other Standards and Regulations

EN 60529:1992+A2:2013 - Degrees of protection provided by enclosures (IP code) – enclosure rated IP66

---

On behalf of European Safety Systems Ltd., I declare that, on the date the equipment accompanied by this declaration is placed on the market, the equipment conforms with all technical and regulatory requirements of the above listed directives, regulations and standards.

This Declaration is issued under the sole responsibility of the manufacturer.

Martin Streetz  
Quality Assurance Manager

Document No.: DC-094\_Issue\_A  
Date and Place of Issue: London, 04/02/2022