



TL23105D

European Safety Systems Limited

Ingress Protection

EN 60529: 1992 + A2: 2013 (IPX8)

Break Glass Manual Call Point STExCP8-BG

19th September 2023





TL23105D Issue 1 Page 2 of 16 19th September 2023

Contents

1	SCOI	PE OF WORK	3
2		IPMENT UNDER TEST	
	-		
3		LABORATORY	
4	TEST	SPECIFICATION, METHODS AND PROCEDURES	6
	4.1	TEST DETAILS	6
	4.2	TEST PROCEDURES	6
5	OPEI	RATION OF THE EUT DURING TESTING	7
	5.1	SYSTEM CONFIGURATION	7
	5.2	ACCEPTANCE CRITERIA	8
6	TEST	RESULTS	9
	6.1	SAMPLESSUMMARY OF TEST RESULTS	9
	6.2	SUMMARY OF TEST RESULTS	.10
	6.3	EQUIPMENT PERFORMANCE	.10
	6.4	IPX8	





TL23105D Issue 1 Page 3 of 16 19th September 2023

1 SCOPE OF WORK

Test requirements

This file contains the results of tests carried out to meet the requirements of EN 60529: 1992 + A2: 2013 (IPX8).

2 EQUIPMENT UNDER TEST

The tests were performed only on the sample shown below:

Description	The EUT is a break glass manual call point for zone 1 and zone 2 hazardous areas for fire and gas
	alarm systems, ESD and process control.

Item	Model	Unique Identifier
Manual Call Point	STExCP8-BG	001

All model numbers and unique identifiers were supplied by the client or taken from the supplied EUT. The sample tested was selected and provided by the client. The laboratory did not sample the selected EUT.

The client stated that the unit tested forms part of a range of products that share the same IP housing. It was decided that testing only one product from the range was necessary as the unit enclosures are identical and the only difference is the internal electronics. This report is only for the model tested.

The following models are units within this range. Only the STExCP8-BG was tested. - STExCP8-BG and WP8-BG form the range of identical units.

Date of Receipt	3 rd August 2023
Date of Testing	24 th August 2023 – 29 th August 2023

Client: European Safety Systems Limited

Unit B Impress House Mansell Road Acton

London W3 7QH

Contact: Mr Randip Rait

Email: Randip.rait@e2s.com

Telephone Number: 020 3470 0135





TL23105D Issue 1 Page 4 of 16 19th September 2023

Test Results

The equipment under test complied with the requirements of the specification. This test report may not be reproduced in whole or part without the prior written approval of the laboratory. The test results in this report are facts and any opinions or interpretations derived from these facts shall be marked *

Signed

Mr. Stephen Lee Laboratory Manager





TL23105D Issue 1 Page 5 of 16 19th September 2023

3 TEST LABORATORY

The tests were carried out at MS Testing, located in Newton Aycliffe, Co. Durham, UK.

Laboratory accreditation:

MS Testing is UKAS Accredited Test Laboratory No. 4413.

Ambient conditions in the laboratory:

PARAMETER	Required (Lloyd's Specification 1)
Temperature °C	15 – 35
Humidity % RH	42 – 78
Barometric pressure mbar	860 - 1060





TL23105D Issue 1 Page 6 of 16 19th September 2023

4 TEST SPECIFICATION, METHODS AND PROCEDURES

4.1 Test Details

The tests detailed in this file are -

	Test	Basic Standard
6.4	Ingress Protection X8 (IPX8)	EN 60529: 1992 + A2: 2013

4.2 Test Procedures

IPX8

The enclosure under test is placed in its normal operating orientation into a pressure vessel and submerged in 200mm of water, the vessel is pressurised so that the EUT experiences the pressure associated with a depth of 35m for 40 hours.






TL23105D Issue 1 Page 7 of 16 19th September 2023

5 OPERATION OF THE EUT DURING TESTING

5.1 System Configuration

The equipment was not powered during any of the testing, the enclosure was checked after the test for ingress as applicable.

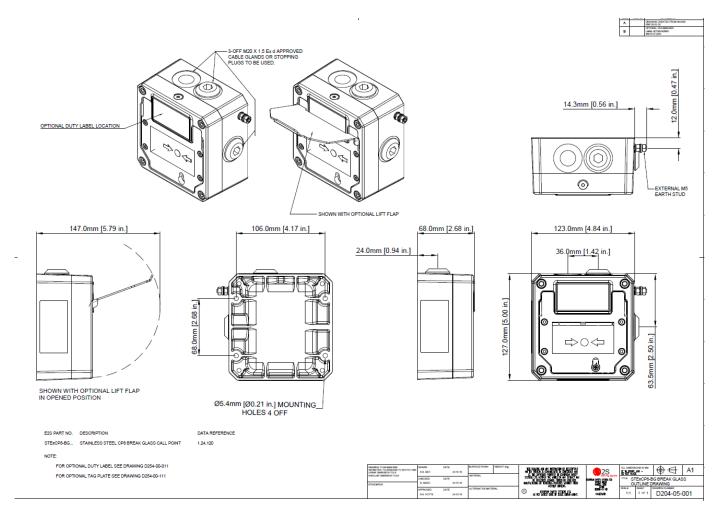





TL23105D Issue 1 Page 8 of 16 19th September 2023

5.2 Acceptance Criteria

IPX8

No water shall enter the enclosure that will either impair safety or correct operation given in the acceptance criterion of the standard.





TL23105D Issue 1 Page 9 of 16 19th September 2023

6 TEST RESULTS

6.1 Samples

The EUT was the original sample with no modifications.





TL23105D Issue 1 Page 10 of 16	19th September 2023
--------------------------------	---------------------

6.2 Summary of test results

Basic Standard	Test	Result	Sample
EN 60529	Ingress Protection IPX8	Complied	1

6.3 Equipment Performance

Specification

The conformance to drawings is checked and a functional performance test is demonstrated to ensure that the system operates in accordance with the customer's instructions where applicable.

Test Procedure

The equipment was checked to ensure it was sealed as the customer required it and to the correct torque.





TL23105D Issue 1	Page 11 of 16	19th September 2023

6.4 IPX8

Basic Standard:	EN 60529: 1992 + A2: 2013	
Applicable:	Enclosure	

Test Result

The enclosure under test is placed into a pressure vessel and submerged in 200 mm of water, it is then pressurised to simulate a depth of 35 m for 40 hours.

The enclosure was opened after the test and there was no ingress of water.






UKAS
TESTING
4413

TL23105D Issue 1 Page 12 of 16 19th September 2023

Test Results



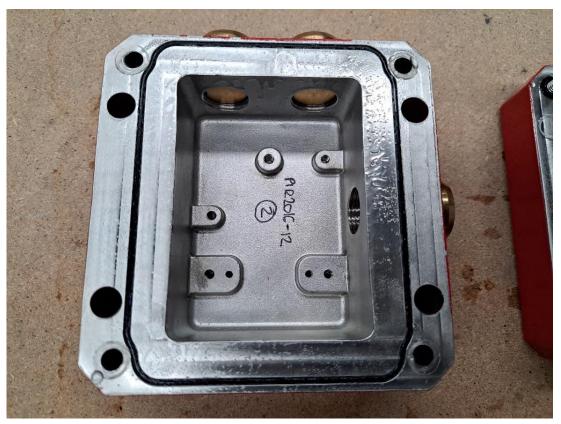




U K A S
TESTING
4413

TL23105D Issue 1 Page 13 of 16 19th September 2023

Test Results

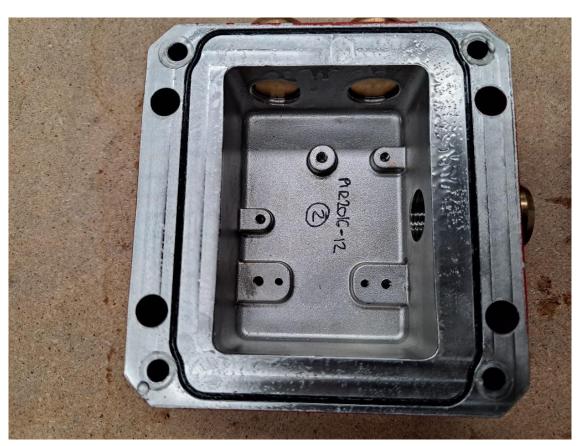



UKAS
TESTING

TL23105D Issue 1 Page 14 of 16 19th September 2023

Test Setup







Test Equipment

Equipment	Model	Serial
Pressure Vessel	-	-
Thermocouple	Fluke 52	6209074
Tape Measure	RS Pro	-

END OF REPORT





1	Original Issue	S. Lee	19th September 2023
ISSUE	MODIFICATION	ISSUED BY	DATE

This test report relates only to the actual item(s) tested, details of which can be found in Section 2 of this report

The test results in this report are facts and any opinions or interpretations derived from the results of these tests shall be \max *

Any testing not presently covered by the scope of our UKAS Schedule of Accreditation shall be marked †

This test report must not be reproduced except in its entirety and with the prior written permission of Mariner Systems (UK) Limited

©2023 Mariner Systems (UK) Limited