




INSTRUCTION & SERVICE MANUAL

A105NSONTEL Telephone Initiated Alarm Sounder

- -40°C to +66C (-40°F to 151°F)
- Type 4 / 4X / 3R / 13, IP66
- 0.75Kg (1.65lb)
- CE & UKCA
- GOST-R approved. Cert: POCC GB-JB05-H00144
- Nominal output: 105dB(A) @ 1m +/- 3dB [96dB(A) @ 10ft/3m]
- No. of tones: 3
- Volume control: Max. 105dB(A); Min. 96dB(A)
- Effective range: 60m/197ft @ 1KHz
- Supply: Direct power from telephone line (REN 1)
- Ingress protection: IP66



Attention: Installation must be carried out by an electrician in compliance with the latest codes and regulations.

Attention: L'installation doit être effectuée par un électricien conformément aux derniers codes et réglementations.

Achtung: Die Installation muss von einem Elektriker gemäß den neuesten Vorschriften und Bestimmungen durchgeführt werden.

Attenzione: L'installazione deve essere eseguita da un elettricista in conformità con i codici e le normative più recenti.

Atención: La instalación debe ser realizada por un electricista de acuerdo con los últimos códigos y regulaciones.

Atenção: A instalação deve ser realizada por um electricista de acordo com os códigos e regulamentos mais recentes.

Внимание: установка должна выполняться электриком в соответствии с последними нормами и правилами.

Attention: Disconnect from power source before installation or service to prevent electric shock

Attention: Débranchez-le de la source d'alimentation avant l'installation ou l'entretien pour éviter tout choc électrique.

Achtung: Vor Installation oder Wartung von der Stromquelle trennen, um einen Stromschlag zu vermeiden.

Attenzione: scollegare dall'alimentazione prima dell'installazione o dell'assistenza per evitare scosse elettriche.


Atención: desconéctelo de la fuente de alimentación antes de la instalación o el servicio para evitar descargas eléctricas.

Atenção: Desconecte da fonte de alimentação antes da instalação ou serviço para evitar choque elétrico


Внимание: отключите от источника питания перед установкой или обслуживанием, чтобы предотвратить поражение электрическим током.



(See D247-06-001)



VOLUME CONTROL





tone table

Tone	Description		
Tone 1	Siren Tone		108dB(A)
Tone 2	Alternating tone		104dB(A)
Tone 3	Sw eeping tone		106dB(A)



dB(A) output figures: +/-3dB(A)

INSTRUCTION & SERVICE MANUAL
A105NSONTEL Telephone Initiated Alarm Sounder

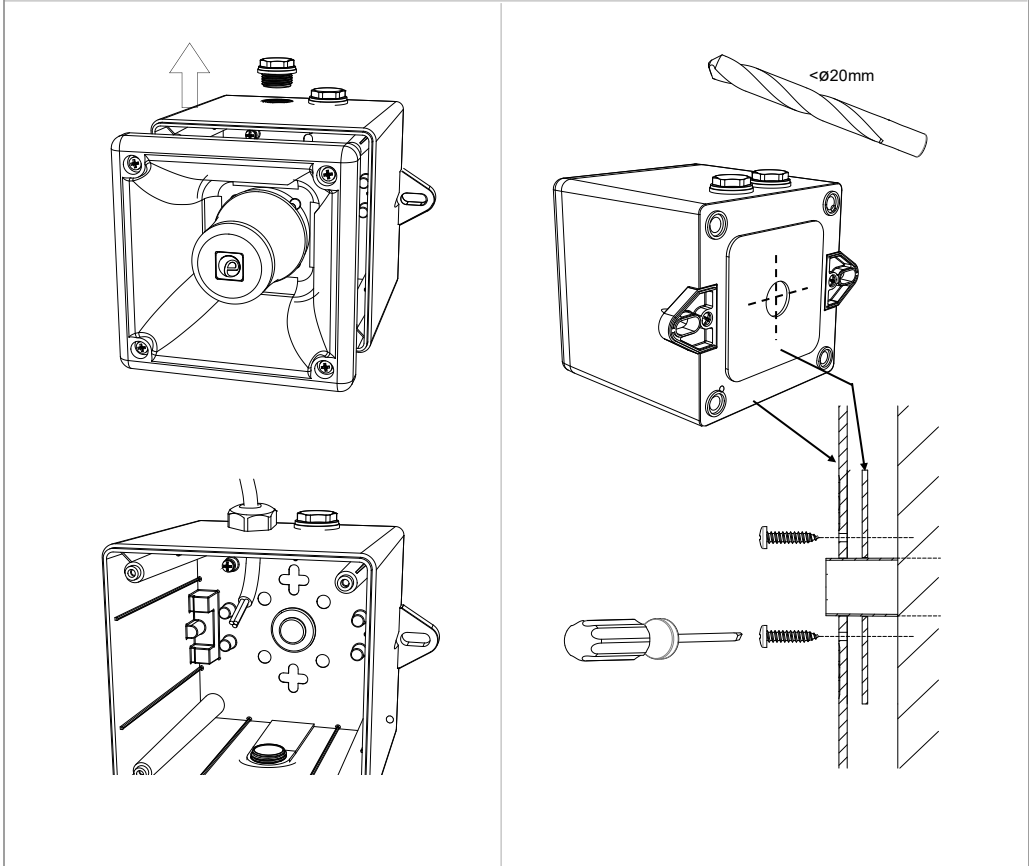
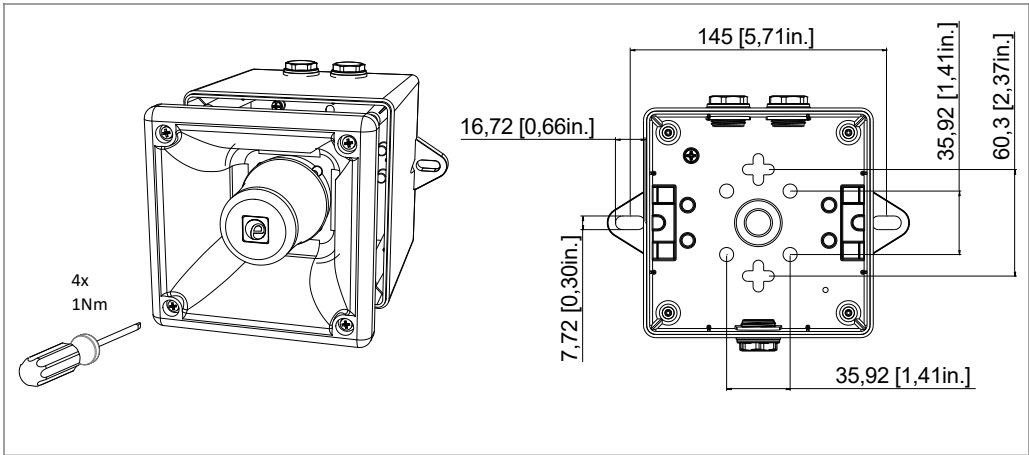


10	ISSUE	MOD No.	REASON - INITIAL - DATE
A	A	INTRODUCTION	JS-30/06/2021

A100/ A105 SONTEL





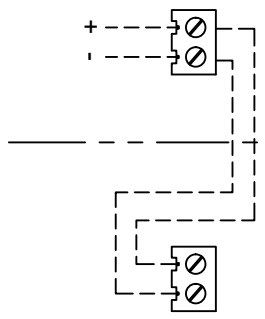




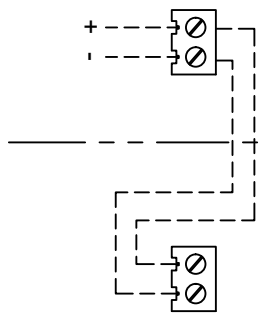

AL100/ AL105 SONTELFASH



230vac +/-10%



A	1	2	3	4	5	6	7	8	9	10																																		
B	A100/ A105 SONTEL																																											
C	AL100/ AL105 SONTELFASH																																											
D	  																																											
E	   <p>230vac +/-10%</p> 																																											
F	 																																											
G	<p>DRAWING TO BS8888:2000 GENERAL PURPOSE TOOLS ANGULAR DIMENSIONAL TOOLS</p> <table border="1" style="width: 100%;"> <tr> <td>DRAWN</td> <td>DATE</td> <td>SURFACE FINISH</td> <td>WEIGHT (KG)</td> </tr> <tr> <td>J. SPILLER</td> <td>30/06/2021</td> <td></td> <td></td> </tr> <tr> <td>CHECKED</td> <td>DATE</td> <td>MATERIAL</td> <td></td> </tr> <tr> <td>B. ISARD</td> <td>30/06/2021</td> <td></td> <td></td> </tr> <tr> <td>APPROVED</td> <td>DATE</td> <td>ALTERNATIVE MATERIAL</td> <td></td> </tr> <tr> <td>R.N.POTTS</td> <td>30/06/2021</td> <td></td> <td></td> </tr> </table> <p>THIS DRAWING AND ANY INFORMATION OR DESCRIPTIVE MATTER THEREIN IS COMMUNICATED IN CONFIDENTIAL SYSTEMS LTD. WHETHER THE WHOLE OR ANY PART MAY BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS OR FOR ANY PURPOSES WITHOUT THE WRITTEN CONSENT OF SYSTEMS LTD.</p> <p>REPRODUCTION OF THIS DRAWING WITHOUT THE WRITTEN CONSENT OF SYSTEMS LTD. IS PROHIBITED.</p> <p>EUROPEAN SAFETY SYSTEMS LTD MANSELL ROAD LONDON VA 10H WWW.ESS.COM</p> <table border="1" style="width: 100%;"> <tr> <td>ALL DIMENSIONS IN MM IF IN QUOTE ASK - DO NOT SCALE</td> <td>TITLE</td> <td>SCALE</td> <td>SHEET</td> <td>DRAWING NUMBER</td> </tr> <tr> <td></td> <td>A100/AL100/A105/AL105 SONTEL / FLASHTEL WIRING SCHEMATIC</td> <td>NTS</td> <td>1 OF 1</td> <td>D247-06-001</td> </tr> </table> <p style="text-align: right;">A3</p>										DRAWN	DATE	SURFACE FINISH	WEIGHT (KG)	J. SPILLER	30/06/2021			CHECKED	DATE	MATERIAL		B. ISARD	30/06/2021			APPROVED	DATE	ALTERNATIVE MATERIAL		R.N.POTTS	30/06/2021			ALL DIMENSIONS IN MM IF IN QUOTE ASK - DO NOT SCALE	TITLE	SCALE	SHEET	DRAWING NUMBER		A100/AL100/A105/AL105 SONTEL / FLASHTEL WIRING SCHEMATIC	NTS	1 OF 1	D247-06-001
DRAWN	DATE	SURFACE FINISH	WEIGHT (KG)																																									
J. SPILLER	30/06/2021																																											
CHECKED	DATE	MATERIAL																																										
B. ISARD	30/06/2021																																											
APPROVED	DATE	ALTERNATIVE MATERIAL																																										
R.N.POTTS	30/06/2021																																											
ALL DIMENSIONS IN MM IF IN QUOTE ASK - DO NOT SCALE	TITLE	SCALE	SHEET	DRAWING NUMBER																																								
	A100/AL100/A105/AL105 SONTEL / FLASHTEL WIRING SCHEMATIC	NTS	1 OF 1	D247-06-001																																								

Page left Intentionally blank