INSTRUCTION MANUAL


GNExCP7-PB-S, GNExCP7-PB-D, GNExCP7-PM-S, GNExCP7-PM-D,


GNExCP7-PT-S, GNExCP7-PT-D Call Point

Class I & II Div 2; UL60947

NEC / CEC / ATEX / IECEx / UKEx Zone 1, 2, 21, 22







GNExCP7-PM & GNExCP7-PT

GNExCP7-PB

1) Product Table

Unit Type Code	Input Voltage	Input Current
Omt Type Code	input voitage	
GNExCP7-PB-S GNExCP7-PB-D GNExCP7-PM-S GNExCP7-PM-D GNExCP7-PT-S GNExCP7-PT-D	250Vac Max	5.0 Max ATEX/IECEx/UKEx 3.33A Max Class Div/Zone
GNExCP7-PB-S GNExCP7-PB-S-L GNExCP7-PB-D GNExCP7-PB-D-L GNExCP7-PM-S GNExCP7-PM-S-L	48Vdc Max	1.0A Max
GNExCP7-PM-D GNExCP7-PM-D-L GNExCP7-PT-S GNExCP7-PT-S-L GNExCP7-PT-D GNExCP7-PT-D-L	24Vdc Max	3.0A Max
GNExCP7-PB-S-C GNExCP7-PB-D-C GNExCP7-PM-S-C GNExCP7-PM-D-C GNExCP7-PT-S-C GNExCP7-PT-D-C	48Vdc Max	20mA Max
	Table 1: Electrical Rat	tings

2) Warnings



WARNINGS:

USE COVER BOLTS CLASS A4-70

DO NOT OPEN WHEN AN EXPLOSIVE ATMOSPHERE IS PRESENT

POTENTIAL ELECTROSTATIC HAZARD - SEE INSTRUCTIONS

FOR INDOOR OR OUTDOOR USE

TO REDUCE THE RISK OF IGNITION OF HAZARDOUS ATMOSPHERES, CONDUIT RUNS MUST HAVE A SEALING FITTING CONNECTED WITHIN 18 INCHES OF CONDUIT

CAUTION - RISK OF ELECTRIC SHOCK - MORE THAN ONE DISCONNECT MAY BE REQUIREDTO DE-ENERGIZE THE **EQUIPMENT BEFORE SERVICING**

AVERTISSEMENT:

UTILISER COUVRIR BOULONS CLASSE A4-70

NE PAS OUVRIR UN PRESENCE D'ATMOSPHERE EXPLOSIVE DANGER POTENTIEL CHARGE ÉLECTROSTATIQUE - VOIR LES INSTRUCTIONS

POUR USAGE INTÉRIEUR OU EXTERIEUR

POUR RÉDUIRE LE RISQUE D'INFLAMMATION DES ATMOSPHÈRES DANGEREUSES, LES CONDUITES DE CONDUIT DOIVENT AVOIR UN RACCORD D'ÉTANCHÉITÉ RACCORDÉ À MOINS DE 18 POUCES DE L'ENFERMEMENT

ATTENTION - RISQUE DE CHOC ELECTRIQUE - PLUSIEURS SECTIONNEURS PEUVENT ETRE NECESSAIRES POUR COUPER L'ALIMENTATION DE L'APPAREILLAGE AVANT D'ENTREPRENDRE L'ENTRETIEN

Marking & Rating Information

The GNExCP7-PB, -PT & -PM Call Points comply with the following standards for hazardous locations:

3.1 Class/Division Ratings for US & Canada



All models are approved for use as Alarm System use:

UL 60947-4-1 LOW-VOLTAGE SWITCHGEAR AND CONTROLGEAR - PART 4-1: CONTACTORS AND MOTORSTARTERS - ELECTROMECHANICAL CONTACTORS AND MOTOR-STARTERS- Edition 3 -Revision Date 2017/10/17

CSA C22.2 NO. 60947-4-1-14 LOW-VOLTAGE SWITCHGEAR AND CONTROLGEAR — PART 4-1: CONTACTORS AND MOTOR-STARTERS -ELECTROMECHANICAL CONTACTORS AND MOTOR-STARTERS- Edition 2 - Issue Date 2014/01/04

For Indoor and Outdoor Use Pour usage Interier INTÉRIEUR

Ambient Temperature Range: -55°C to +60°C

Standards							
UL 60079-0:2017 (Ed 6 General requirements	UL 60079-0:2017 (Ed 6): Explosive Atmospheres - Part 0: Equipment -						
1): Explosive Atmospheres - Part 1: Equipment of enclosures "d"						
	2): Explosive Atmospheres - Part 31: Equipment						
Equipment – General re CSA C22.2 NO. 60079- Equipment protection b CSA C22.2 NO. 60079-	-0:2015 (Ed 3) Explosive Atmospheres – Part 0: quirements -1:2016 (Ed 3): Explosive Atmospheres – Part 1: y flameproof enclosures "d" -31:2015 (Ed 2): Explosive Atmospheres – Part 31: a protection by enclosure "t"						
Class Division	Ratings for US (NEC) & Canada (CEC)						
Model No:	Rating						
GNEXCP7-PB-S GNEXCP7-PB-S-L GNEXCP7-PB-S-C GNEXCP7-PB-D GNEXCP7-PB-D-L GNEXCP7-PB-D-C GNEXCP7-PM-S GNEXCP7-PM-S-L	Class I Div 2 Group ABCD T6 Ta -55°C to +60°C Class II Div 2 Group FG T5 Ta -55°C to +60°C Class III Div 2 Ta -55°C to +60°C						

GNEXCP7-PM-S-C GNEXCP7-PM-D GNEXCP7-PM-D-L GNEXCP7-PM-D-C GNEXCP7-PT-S GNEXCP7-PT-S-L GNEXCP7-PT-S-C GNEXCP7-PT-D GNEXCP7-PT-D-L GNEXCP7-PT-D-C		

Class Zone Ratings for US (NEC)

Model No:	Rating
GNEXCP7-PB-S GNEXCP7-PB-S-L GNEXCP7-PB-S-C GNEXCP7-PM-S GNEXCP7-PM-S-L GNEXCP7-PM-S-C GNEXCP7-PT-S GNEXCP7-PT-S-L GNEXCP7-PT-S-C	Class I Zone 1 AEx db IIC T6 Gb Ta -55°C to +60°C Zone 21 AEx tb IIIC T75°C Db Ta -55°C to +60°C
GNEXCP7-PB-D GNEXCP7-PB-D-L GNEXCP7-PB-D-C GNEXCP7-PM-D GNEXCP7-PM-D-L GNEXCP7-PM-D-C GNEXCP7-PT-D GNEXCP7-PT-D-L GNEXCP7-PT-D-C	Class I Zone 1 AEx db IIC T6 Gb Ta -55°C to +60°C Zone 21 AEx tb IIIC T90°C Db Ta -55°C to +60°C

Class Zone Ratings for Canada (CEC)

Model No:	Rating
GNEXCP7-PB-S GNEXCP7-PB-S-L GNEXCP7-PB-S-C GNEXCP7-PM-S GNEXCP7-PM-S-L GNEXCP7-PM-S-C GNEXCP7-PT-S GNEXCP7-PT-S-L GNEXCP7-PT-S-C	Ex db IIC T6 Gb Ta -55°C to +60°C Ex tb IIIC T75°C Db Ta -55°C to +60°C
GNEXCP7-PB-D GNEXCP7-PB-D-L GNEXCP7-PB-D-C GNEXCP7-PM-D GNEXCP7-PM-D-L GNEXCP7-PM-D-C GNEXCP7-PT-D GNEXCP7-PT-D-L GNEXCP7-PT-D-C	Ex db IIC T6 Gb X Ta -55°C to +60°C Ex tb IIIC T90°C Db Ta -55°C to +60°C

Installation must be carried out in compliance with the National Electric Code / Canadian Electric Code

3.2 ATEX / IECEx & UKEx Ratings

EN60079-0:2018/IEC60079-0:2017 (ed.7): Explosive Atmospheres - Equipment General Requirements. EN60079-1:2014/IEC60079-1:2014 (ed.7): Explosive Atmospheres - Equipment Protection by Flameproof Enclosures "d". EN60079-31:2014/IEC60079-31:2022 (ed.3): Explosive Atmospheres - Equipment Dust Ignition Protection by enclosure "t".							
Model No:	Rating						
GNEXCP7-PB-S GNEXCP7-PB-S-L GNEXCP7-PB-S-C GNEXCP7-PM-S GNEXCP7-PM-S-L GNEXCP7-PT-S-C GNEXCP7-PT-S-L GNEXCP7-PT-S-L GNEXCP7-PT-S-C	Ex db IIC T5 Gb Ta –55°C to +70°C Ex db IIC T6 Gb Ta –55°C to +65°C Ex tb IIIC T85°C Db Ta –55°C to +70°C						
GNExCP7-PB-D GNExCP7-PM-D GNExCP7-PT-D	Ex db IIC T5 Gb Ta -55°C to +70°C Ex db IIC T6 Gb Ta -55°C to +60°C Ex tb IIIC T90°C Db Ta -55°C to +70°C						
GNEXCP7-PB-D-L GNEXCP7-PB-D-C GNEXCP7-PM-D-L GNEXCP7-PM-D-C GNEXCP7-PT-D-L GNEXCP7-PT-D-C	Ex db IIC T4 Gb Ta -55°C to +70°C Ex db IIC T5 Gb Ta -55°C to +65°C Ex db IIC T6 Gb Ta -55°C to +50°C Ex tb IIIC T100°C Db Ta -55°C to +70°C						
See Product table for el	ectrical ratings of each unit model						

Standards

Certificate No. DEMKO 19 ATEX 2101X IECEx ULD 19.0007X UKEx UL UL21UKEX2134X

Epsilon x Equipment Group and Category:

II 2G II 2D

CE Marking and Notified Body No.

UKCA Marking and Notified Body No.



2813



0518

3.3 **DNV Type Approval**

The units have been tested and approved for the installation on ships in the following locations:

Class A,B,C & D (all locations including Temperature:

open decks and masts)

Humidity: Class A & B (all locations)

Vibration: Class A (all locations except installation on

machinery such as combustion engines, compressors, pumps, including piping on

such machinery)

EMC: Class A & B (all locations including open

decks and bridge)

Enclosure: Class A, B & C - IP56 (all locations except

submerged applications and bilges)

4) Zones, Gas Group, Category and **Temperature Classification**

	Area Classification Gas
Zone 1	Explosive gas air mixture likely to occur in normal operation.
Zone 2	Explosive gas air mixture not likely to occur in normal operation, and if it does, it will only exist for a short time
	Gas Groupings
Group IIA	Propane
Group IIB	Ethylene
Group IIC	Hydrogen and Acetylene
Te	mperature Classification for Gas Applications
T1	450° C
T2	300° C
T3	200° C
T4	135° C
T5	100°C (GNexCP7-P*-D-L up to 65°C ambient)
Т6	85°C (GNExCP7-P*-S up to 65°C ambient) (GNExCP7-P*-D up to 60°C ambient) (GNExCP7-P*-D-L up to 50°C ambient)
	Area Classification Dust
Zone 21	Explosive dust air mixture likely to occur in normal operation.
Zone 22	Explosive dust air mixture not likely to occur in normal operation, and if it does, it will only exist for a short time
	Dust Groupings
Group IIIA	Combustible Dusts
Group IIIB	Non-Conductive Dusts
Group IIIC	Conductive Dusts
	Equipment Category
2G, 2D	
	Equipment Protection Level
Gb, Gc, Db, Dc	
Maxi	mum Surface Temperature for Dust Applications
90°C (G 100°C (GNE	GNEXCP7-PB-S; GNEXCP7-PT-S; GNEXCP7-PM-S) ATEX/IECEx/UKEx NEXCP7-PB-D; GNEXCP7-PT-D; GNEXCP7-PM-D) ATEX/IECEx/UKEx EXCP7-PB-D-L; GNEXCP7-PB-D-C; GNEXCP7-PT-D-L; P7-PT-D-C; GNEXCP7-PM-D-L; GNEXCP7-PM-D-C) ATEX/IECEx/UKEx
	7-PB-S; GNExCP7- PB -S-L; GNExCP7- PB -S-C; GNExCP7-PTS-L; GNExCP7- PT -S-C; GNExCP7- PM -S-L GNExCP7- PM -S-C;) Class Zone
	7-PB-D ; GNExCP7- PB -D-L ; GNExCP7- PB -D-C ; GNExCP7-PT Γ -D-L ; GNExCP7- PT -D-C ; GNExCP7-PM-D ; GNExCP7- PM -L L ; GNExCP7- PM -D-C ;) Class Zone
	Ambient Temperature Range
	(-67°F to +158°F) ATEX/IECEx/UKEx (-67°F to +140°F) Class Zone
	IP Rating
IP66/67/68 to E	N/IEC60529 and IP6X to EN/IEC60079-0, EN/IEC60079-3

Installation must be carried out in compliance with the latest issue of the following standards:

EN60079-14 / IEC60079-14: Explosive atmospheres - Electrical installations design, selection and erection

EN60079-10-1 / IEC60079-10-1: Explosive atmospheres Classification of areas. Explosive gas atmospheres

EN60079-10-2 / IEC60079-10-2: Explosive atmospheres - Classification of areas. Explosive dust atmospheres

Pollution Degree: 3

Special Conditions of Use

The stainless steel button is not earthed and may generate an ignition-capable level of electrostatic charges. It has a max capacitance of 6.33pF according to EN/IEC60079-0, clause 7.5.

Equipment is permitted to be wall mounted only in vertical position. The enclosure base is permitted in two mounting positions, with the double entry lowermost or uppermost.









Flame Path Positions

No repair to the Flamepaths is permitted






Location and Mounting

The location of the call point should enable ease of access for operation and testing. The unit should be mounted using the 4 off fixing holes which will accept up to M5 sized fixings. They should only be fixed to services that can carry the weight of the unit.

To gain access to the mounting holes in the base the front cover must be removed. See Section 7.

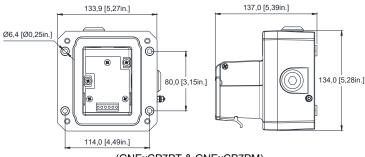

(GNExCP7PT & GNExCP7PM)




Fig. 1 View of base unit showing fixing centres (in mm).

Access to the Flameproof Enclosure 8)



Warning - High voltage may be present, risk of electric shock. DO NOT open when energised, disconnect power before opening.



Warning - Hot surfaces. External surfaces and internal components may be hot after operation, take care when handling the equipment.

To access the Ex d chamber, remove the four off M6 x 50 hexagon socket head screws and withdraw the flameproof cover taking extreme care not to damage the flameproof joints in the process. M6 cover screws are Class A4-70 stainless steel and only screws of this category can be used for the enclosure.

On completion of the installation, the flameproof joints should be inspected to ensure that they are clean and that they have not been damaged during installation.

Once the screws are removed the cover will hang down out of the way to gain access to the terminals, the internal earth terminal and mounting hole recesses.

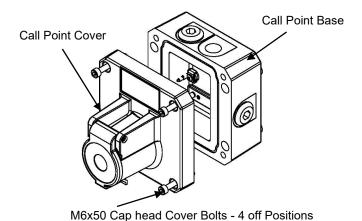


Fig. 2 Accessing the Explosion proof Enclosure.

Check that the earth bonding wire between the two castings is secure and the 'O' ring seal is in place.

When fitting the flameproof cover ensure the cover is sitting flat and correctly positioned on the base. Insert the M6 x 50 stainless steel A4-70 Cap Head cover bolts and fully tighten down (tightening torque 3.5Nm), ensuring no gap is visible between the cover and base of the enclosure.

The enclosure is non-conductive and may generate an ignition-capable level of electrostatic charges under certain extreme conditions. The user should ensure that the equipment is not installed in a location where it may be subjected to external conditions that might cause a build-up of electrostatic charges on non-conducting surfaces.

Additionally, cleaning of the equipment should be done only with a damp cloth.


9) Earthing

Bonding between conduit connections is not automatic and must be provided as part of the installation. Use of suitable grounding hubs and jumper wires are required.

The units are provided with internal and external earth terminals which are mounted in the base of the unit.

Internal earthing connections should be made to the Internal Earth terminal in the base of the housing using a ring crimp terminal to secure the earth conductor under the earth clamp. The earth conductor should be at least equal in size and rating to the incoming power conductors.

When using the internal earth terminal ensure that the stainless steel M4 flat washer is between the incoming earth wire and the enclosure.

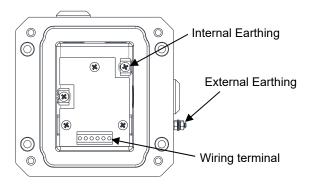

10) Power Supply Selection

Electrical Ratings

See table 1

250Vac max. / 5.0A max (3.33A max NEC/CEC)

48Vdc max. / 1.0A max 24Vdc max / 3.0A max

48Vdc max / 20mA (LED -C option with no ballast resistor)

11) Selection of Cable. Cable Glands, Blanking **Elements & Adapters**

ATEX/IECEX & UKEX Installations:

The equipment must only be installed by suitably qualified personnel in accordance with the latest issues of the relevant standards:

EN60079-14 / IEC60079-14: Explosive atmospheres -Electrical installations design, selection and erection EN60079-10-1 / IEC60079-10-1: Explosive atmospheres -Classification of areas. Explosive gas atmospheres

The installation of the units must also be in accordance with any local codes that may apply and should only be carried out by a competent electrical engineer who has the necessary training.

The equipment must not be installed with any obstruction to the flanged flameproof joint any closer than permitted as per EN/IEC60079-14, table 13.

For high ambient temperatures the cable entry temperature may exceed +70°C or the cable branching point temperature may exceed 80°C and therefore suitable heat resisting cables and cable glands must be used, with a rated service temperature of at least the values stated below:

For Single Switch model GNExCP7-P*-S:

Max. ambient temperature °C	55	60	65	70
req. Cable / Cable Gland rating: °C	80	85	90	95

For Dual Switch models GNExCP7-P*-D:

1 of Badi Cwitch modele CI12xOI 1 I B.							
Max. ambient temperature °C	40	45	50	55	60	65	70
req. Cable /	85	90	95	100	105	110	115
Cable Gland							
rating: °C							

The cable gland entries have an M20 x 1.5 entry thread. Only suitably rated ATEX / IECEx or UKEx certified cable glands which must be suitable for the type of cable being used and also meet the requirements of the current Ex 'd' flameproof installation standards EN 60079-14 / IEC60079-14.

When only one cable entry is used the other entries must be closed with suitably rated ATEX / IECEx or UKEx certified blanking plugs that meet the requirements of the current Ex 'db' and Ex 'tb' flameproof installation standards EN 60079-14 / IEC60079-14 (tightening torque 10Nm).

The stainless steel lift flap is not earthed and may generate an ignition-capable level of electrostatic charges. It has a max

Sheet 5 of 8

capacitance of 6.33pF according to EN/IEC60079-0, clause 7.5.

Caution do not change factory applied finishes

NEC / CEC Installations:

The equipment must only be installed by suitably qualified personnel in accordance with the latest issues of the relevant standards:

The installation of the units must also be in accordance with any local codes that may apply and should only be carried out by a competent electrical engineer who has the necessary training.

The equipment must not be installed with any obstruction to the flanged flameproof joint any closer than permitted as per the NEC/CEC.

For high ambient temperatures the cable entry temperature may exceed +60°C or the cable branching point temperature may exceed 60°C and therefore suitable heat resisting cables and cable glands must be used, with a rated service temperature of at least the values stated below:

For Single Switch model GNFxCP7-P*-S:

i oi oiligic c	1 of olingic owiton model of the Xor 7-1 -o.							
Max. ambient temperature °C	35	40	45	50	55	60		
req. Cable / Cable Gland rating: °C	60	65	70	75	80	85		

For Dual Switch model GNExCP7-P*-D:

Max. ambient temperature	20	25	30	35	40	45	50	55	60
°C req. Cable / Cable Gland rating: °C	65	70	75	80	85	90	95	100	105

For use in Class I Division II locations, in order to maintain the db type protection, flameproof conduit seals and/or cable glands must be used.

The cable gland entries have an M20 x 1.5 entry thread. Only suitably rated and certified cable glands which must be suitable for the type of cable being used and also meet the requirements of the current Ex 'db' and Ex 'tb' flameproof and NEC/CEC installation standards (tightening torque 10Nm).

When only one cable entry is used the other entries must be closed with suitably rated and certified blanking plugs that meet the requirements of the current Ex 'db' and Ex 'tb' flameproof and NEC/CEC installation standards (tightening torque 10Nm).

All Installations:

To access the Ex d chamber, remove the four off M6 x 60 stainless steel A4-70 Cap Head cover bolts.

If the installation is made using conduit, openings must have a sealing fitting connected as close as practical to the wall of the enclosure, but in no case more than the size of the conduit or 2" of enclosure, whichever is the lesser.

Electrical connections are to be made into the PCB / terminal blocks / DIN rail provided.

Internal earthing connections should be made to the Internal Earth terminal on the PCBA. The earth conductor should be at least equal in size and rating to the incoming power conductors.

On completion of the installation the flameproof joint surfaces should be inspected to ensure that they are clean and that they have not been damaged during installation. Flamepaths are not intended to be repaired.

When fitting the flameproof cover ensure the cover is sitting flat and correctly positioned on the base. Insert the M6 x 60 stainless steel A4-70 Cap Head cover bolts and fully tighten down (tightening torque 3.5Nm), ensuring no gap is visible between the cover and base of the enclosure.

If a high IP (Ingress Protection) rating is required then a suitable sealing washer must be fitted under the cable glands or blanking plugs.

The enclosure is non-conducting and may generate an ignition-capable level of electrostatic charges under certain extreme conditions. The user should ensure that the equipment is not installed in a location where it may be subjected to external conditions that might cause a build-up of electrostatic charges on non-conducting surfaces.

The GNExCP7 Call Point range can be supplied with the following types of adapters:

M20 to ½" NPT M20 to ¾" NPT M20 to M25

It is important to note that stopping plugs cannot be fitted onto adapters, only directly onto the M20 entries.

Any other adapters used must be suitably rated and ATEX / IECEx / UKEx or NEC/CEC certified adapters.

12) Cable Connections

The units come with two options.

A DIN rail version which has 8-way connection and allows for limited wiring of EOL devices by customer, or, full pre-wired configurations if outlined with order to E2S.

For full wiring details see wiring diagrams D202-06-211

The PCB Terminal Version has a 6-way connector but is designed to allow for full customer configuration with Series and EOL devices in a number of wiring configurations. For full wiring details see wiring diagrams D202-06-212

For EOL and Series device limitations and configurations see Section 15. Fitting can be requested by E2S at the order stage or added to the correct terminal blocks afterward. All devices must comply with the requirements stipulated in section 15.

Electrical Connections are to be made into the terminal blocks using solid or stranded wire.

Wires having a cross sectional area between 0.5 mm² to 2.5mm² (AWG 20 - 14) can be connected to each terminal way.

In most configuration an input and output wire can be fitted to individual terminals, where these are more complex and if fitting 2-off wires to one terminal way, the sum of the 2-off wires must be a maximum cross sectional area of 2.5mm².

Strip wires to 8mm. Wires may also be fitted using ferrules.

Terminal screws need to be tightened down with a tightening torque of 0.45 Nm / 5 Lb-in.

DIN Rail Terminals: 0.51 Nm / 4.5 Lb-in; Connector Block Terminals: 0.87 Nm / 7.7 Lb-in;

PCBA P1 Terminals: 0.45 Nm / 4.0 Lb-in;

PCBA EOL and Series (1 & 2) Terminals: 0.38 Nm / 3.4 Lb-in

When connecting wires to the terminals great care should be taken to dress the wires so that when the cover is inserted into the chamber the wires do not exert excess pressure on the terminal blocks. This is particularly important when using cables with large cross sectional areas such as 2.5mm².

13) Testing unit operation

The push button types -PB -PT and -PM are all operated by pressing in the main plunger down activating the switch.

PB - Dual Action Push Button

The -PB plunger needs to be firstly twisted by 90 degrees clockwise to position shown and then pressed in. There will be a click sound to indicate positive engagement and the plunger will stay in place.




Fig 6 -PB Version Twist and Push Action

On -PB versions, the plunger will remain in position until the unit is reset. This is done by pulling the plunger back up to the start position shown in fig 6. Then the plunger is twisted back 90 degrees anti-clockwise to the stop.

PM - Momentary Push Button

The -PM needs to have the protective flip lid opened first and then the main plunger pressed in. There will be a click sound to indicate positive engagement, the plunger will spring back up if not held pressed.




Fig 7 -PM Version Push Action

On -PM versions the operation is momentary and as such the plunger will reset automatically once the pressure on the plunger is released.

PT - Tool Reset Push Button

The -PT needs to have the protective flip lid opened first and then the main plunger pressed in. There will be a click sound to indicate positive engagement and the plunger will stay in place.

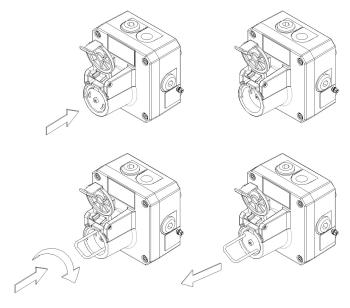


Fig 8a -PT Version Push Action

To reset, insert the reset tool supplied with the unit into the 2off holes in the button plate, rotate clockwise along the curved slots and then pull the button plate back up. Rotate the tool anti clockwise and remove through the 2-off holes in the button plate.

14) End-of-Line and Series Devices

All models can be fitted with series resistors, end-of-line monitoring resistors, monitoring diodes and zener diodes if supplied with direct current up to 48Vdc and limited to a maximum total power consumption no greater than 6.224W.

Min. resistor values and current limitations must be observed depending on supply voltage and type of components fitted. If a combination of resistors / diodes / zener diodes is used, values for all components must be observed and lowest current limit for either component becomes overall limit.

Current limitation for units fitted with end-of-line resistors, diodes or zener diodes must be ensured by using a current limited power supply or fitting a current limiting resistor at the control panel (not provided).

The following table 1 shows limitations for all possible variations:

	Supply voltage	je 24Vdc	Supply voltag	e 48Vdc
Type of component fitted	value	Max. current (mA)	value	Max. current (mA)
End-of-Line Resistor *See note	min. 470R/ 2W or min. 2k2/ 0.5W	3000	min. 2k2/ 2W or min. 8k2/ 0.5W	1000
End-of-Line Diode Type 1N5401	2W	59.13	2W	25.26
Series Resistor *See note	min. 470R/ 2W or min. 2k2/ 0.5W	3000	min. 2k2/ 2W or min. 8k2/ 0.5W	1000
Series Diode Type 1N5401	2W	59.13	2W	25.26
	3.3V	230	3.3V	230
	4.7V	162	4.7V	162
Series	5.1V	149	5.1V	149
Zener	5.6V	136	5.6V	136
Diode Type	6.2V	122	6.2V	122
1N5333B	6.8V	112	6.8V	112
	10V	76	10V	76
	12V	63	12V	63

Note: - The maximum voltage stated must not be exceeded, as the internal resistor modules are rated as compliant with Ex d according to the unit voltage.

If lower value resistors than seen on table are required it may be possible to configure but seek advice from E2S to ensure compliance is still maintained.

EOL (End of line) device;

resistor – ExxxR

diode – ED1

• zener – ExxxZ

Series (In line) device;

- resistor SxxxR
- diode SD1
- zener SxxxZ
- LFD

Microswitch 1 = M/S 1Microswitch 2 = M/S 2

The unit can be wired with a maximum of 4 module devices – see wiring schematic D202-06-211

When customer is fitting EOL or Series devices, ensure device leads are insulated or routed so as not to create an electrical short.


An optional Ex d LED monitoring module is designated after the model no as either,

GNExCP7-BG-S-L or GNExCP7-BG-D-L to include an LED and power limiting resistor

or,

GNEXCP7-BG-S-C or GNEXCP7-BG-D-C with includes the LED but where the units current must be limited to 20mA.

The optional Ex d LED monitoring module is fitted in the M20 side entry as shown, when the main M20 entries are at the bottom of unit. The wiring is shown as per wiring diagram. D202-06-211 see the various LED configuration options.

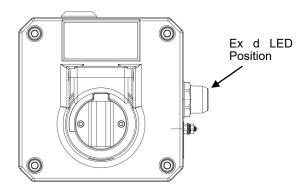

15) Maintenance, Overhaul & Repair

Maintenance, repair and overhaul of the equipment should only be carried out by suitably qualified personnel in accordance with the current relevant standards:

EN60079-19/IEC60079-19 Explosive atmospheres Equipment repair, overhaul and reclamation

EN60079-17/IEC60079-17 Explosive atmospheres Electrical installations inspection and maintenance

To avoid a possible ELECTROSTACTIC CHARGE the unit must only be cleaned with a damp cloth.

Units must not be opened while an explosive atmosphere is present.

16) SIL 2 Reliability Data


Reliability and Functional safety IEC/EN61508 which has been assessed and is considered suitable for use in low demand safety function:


- Random Hardware Failures and Systematic Failures (route 2H)
- As an unvoted item (i.e. hardware fault tolerance of 0) at SIL 2


The product was assessed against failure modes:


- Failure to close a contact when the call point is struck with specified force
- Failure to open a contact when the call point is struck with specified force
- · Spurious output despite no input


Integrity in respect of failure to close	SIL 2
System Type	Α
Hardware Fault Tolerance	0
Safe Failure Fraction (credible claim)	75%
PFD (hazardous failure)	2.3 x 10 ⁻³
Proof Test Interval	Up to 1 year

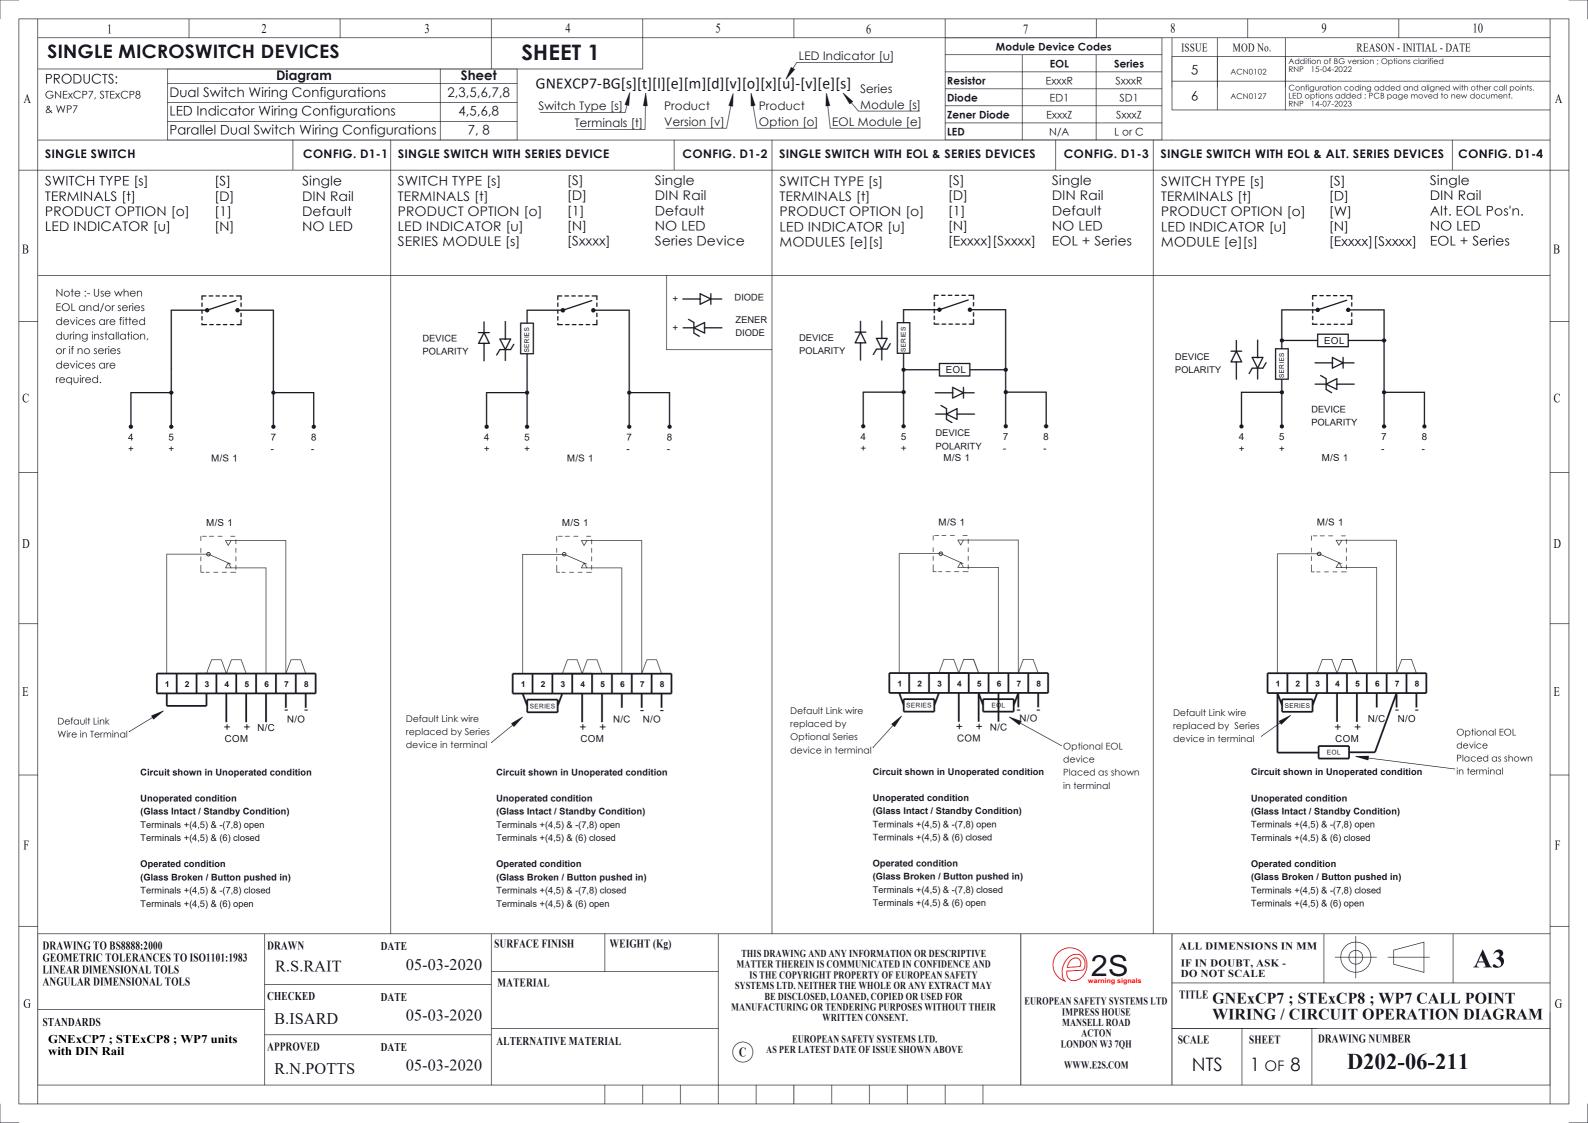


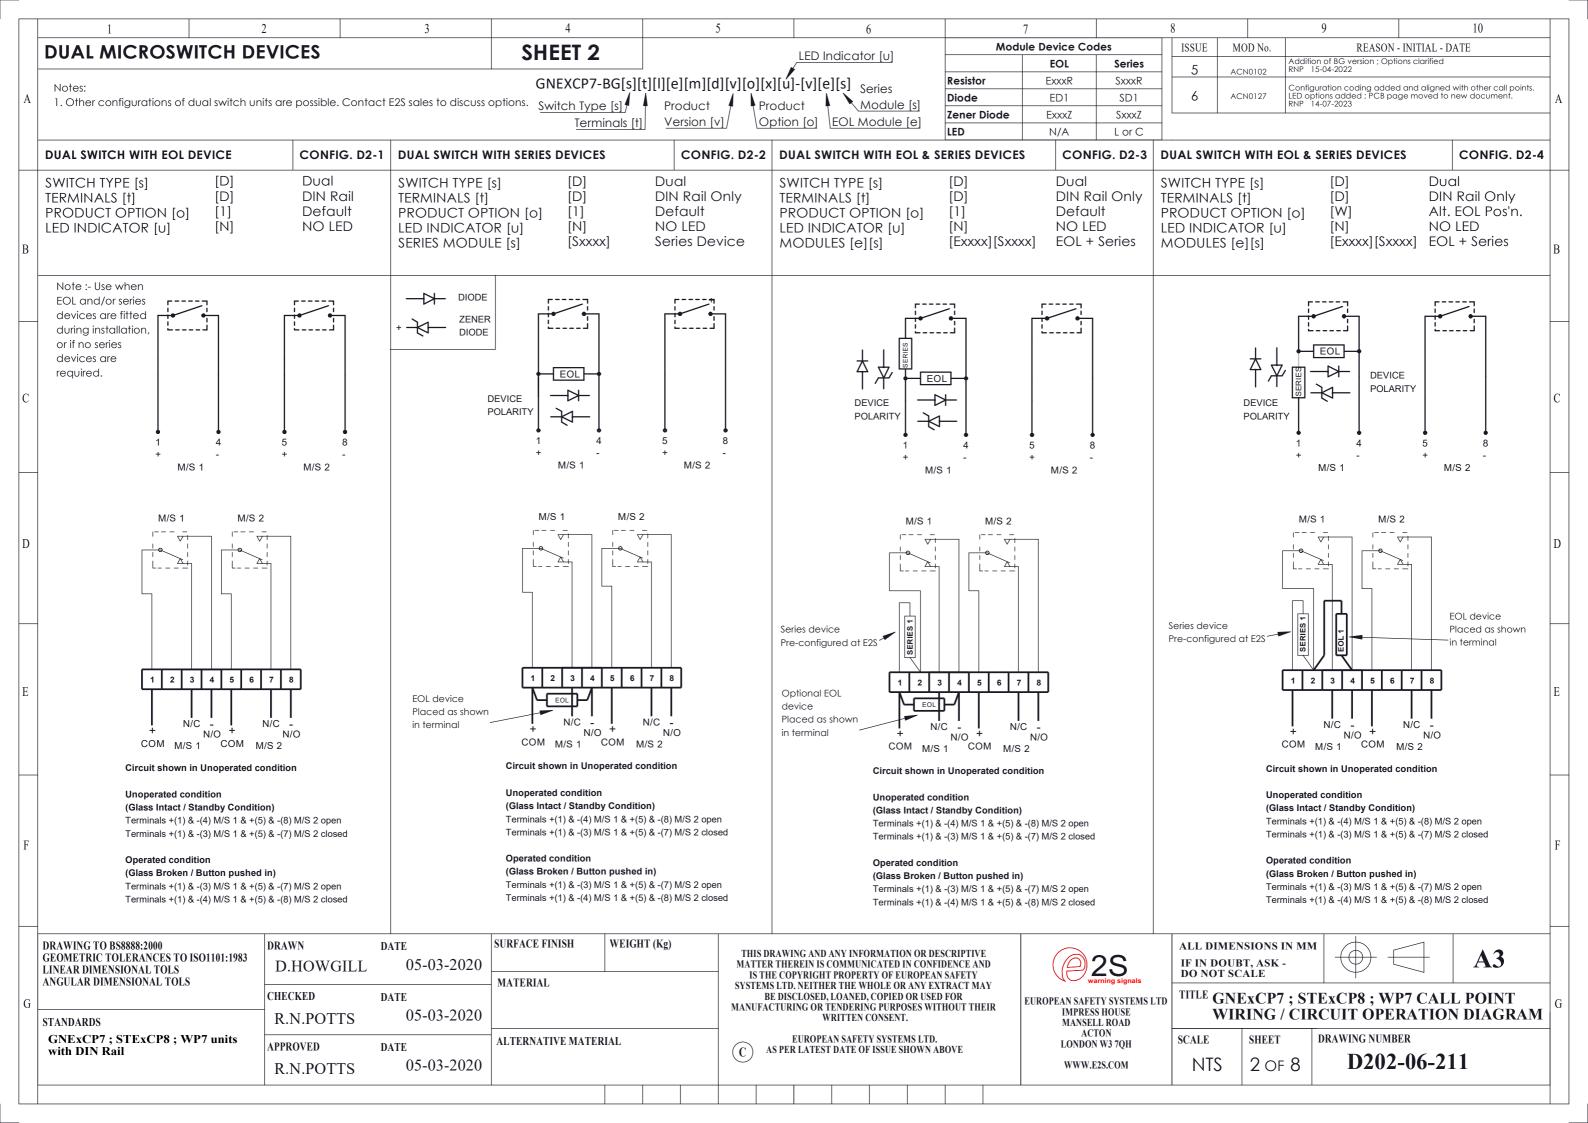


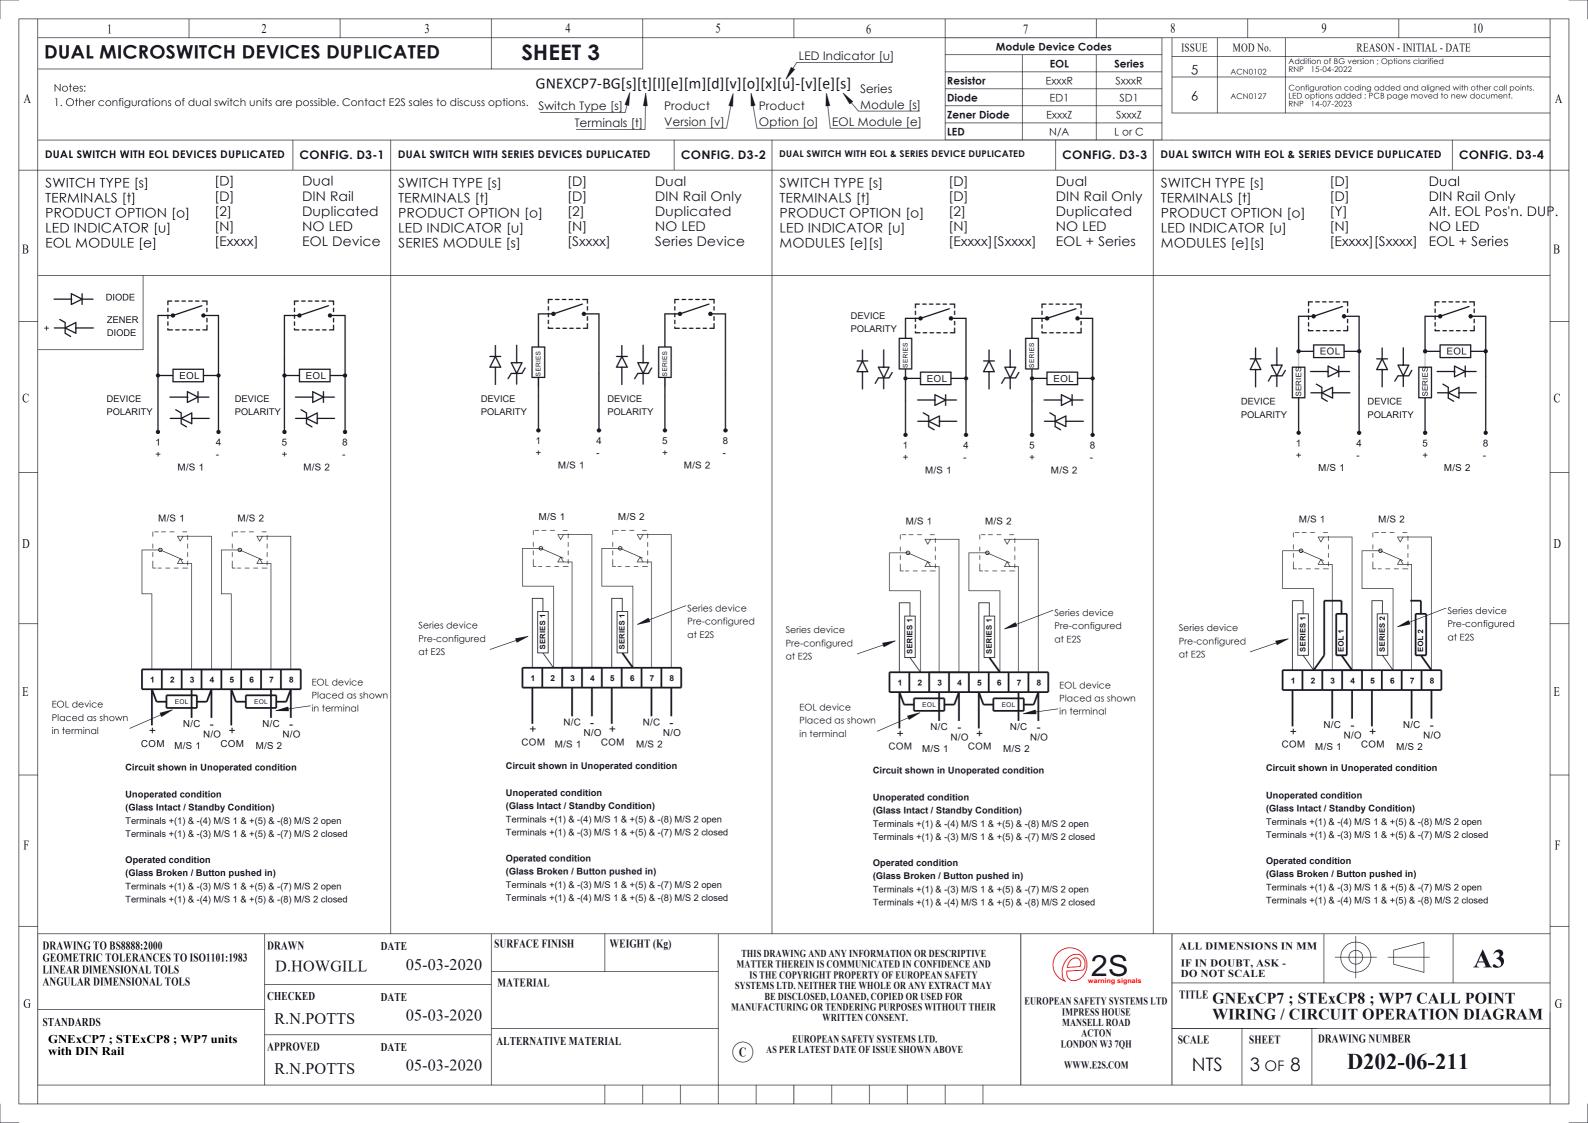


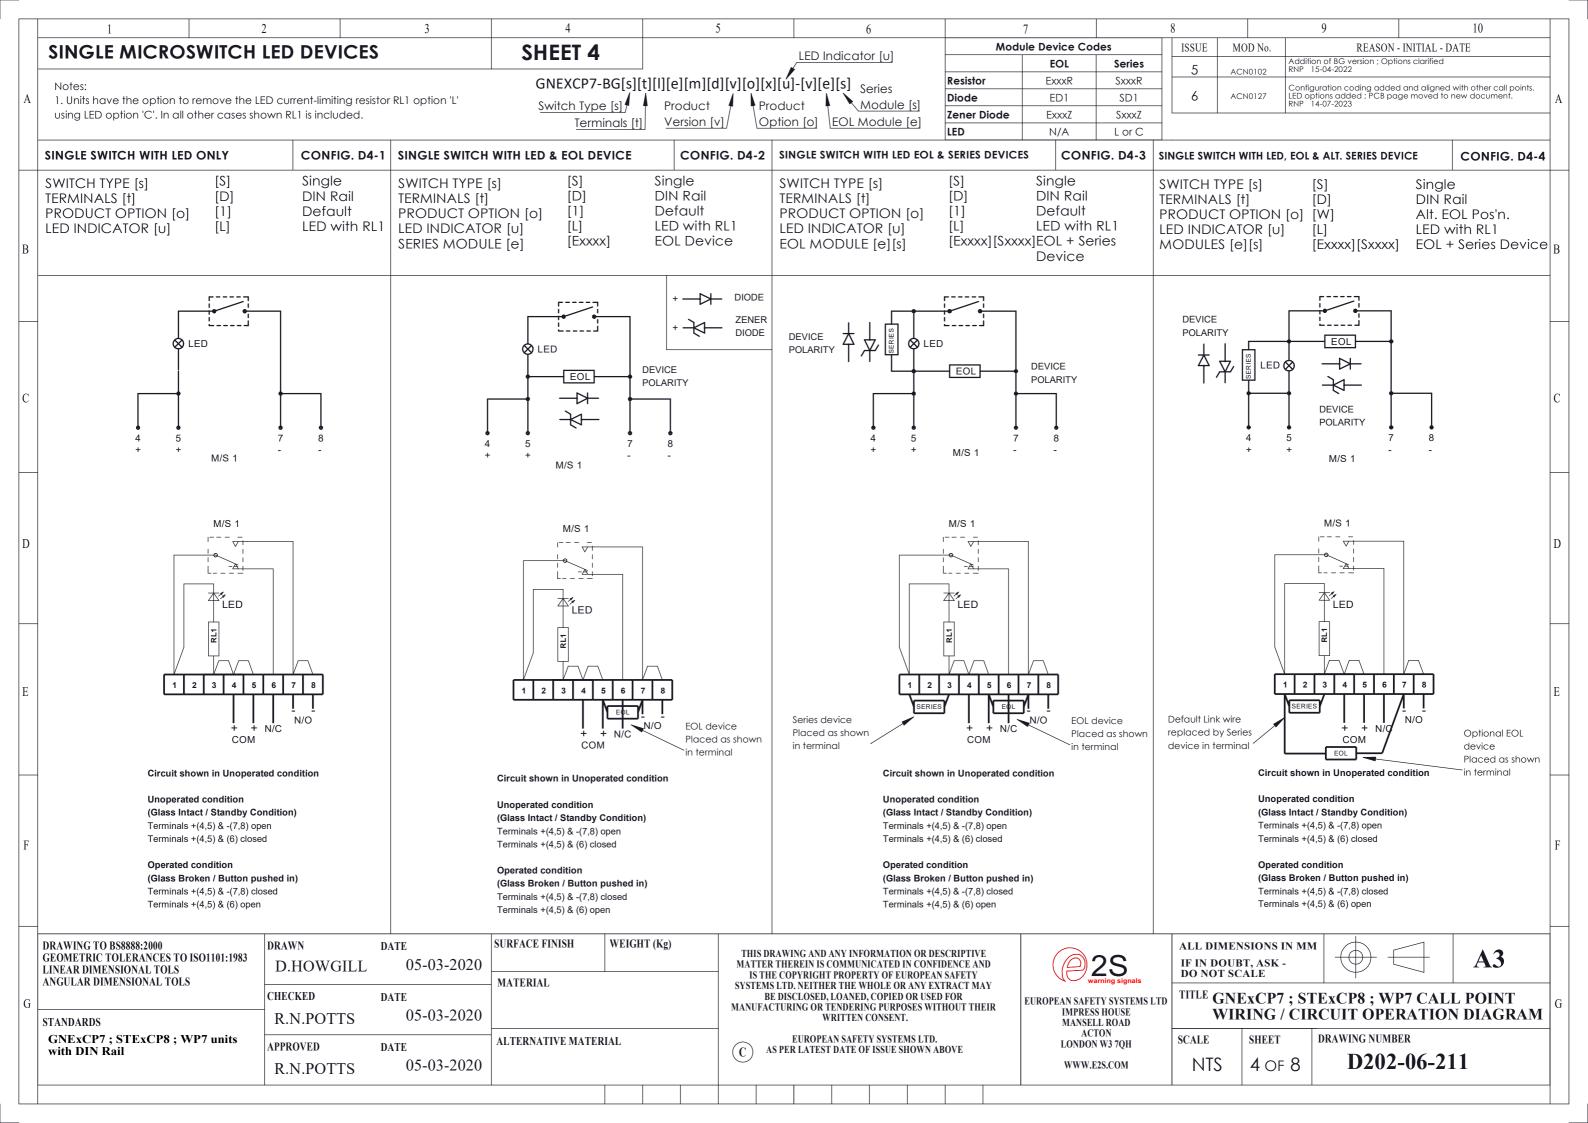


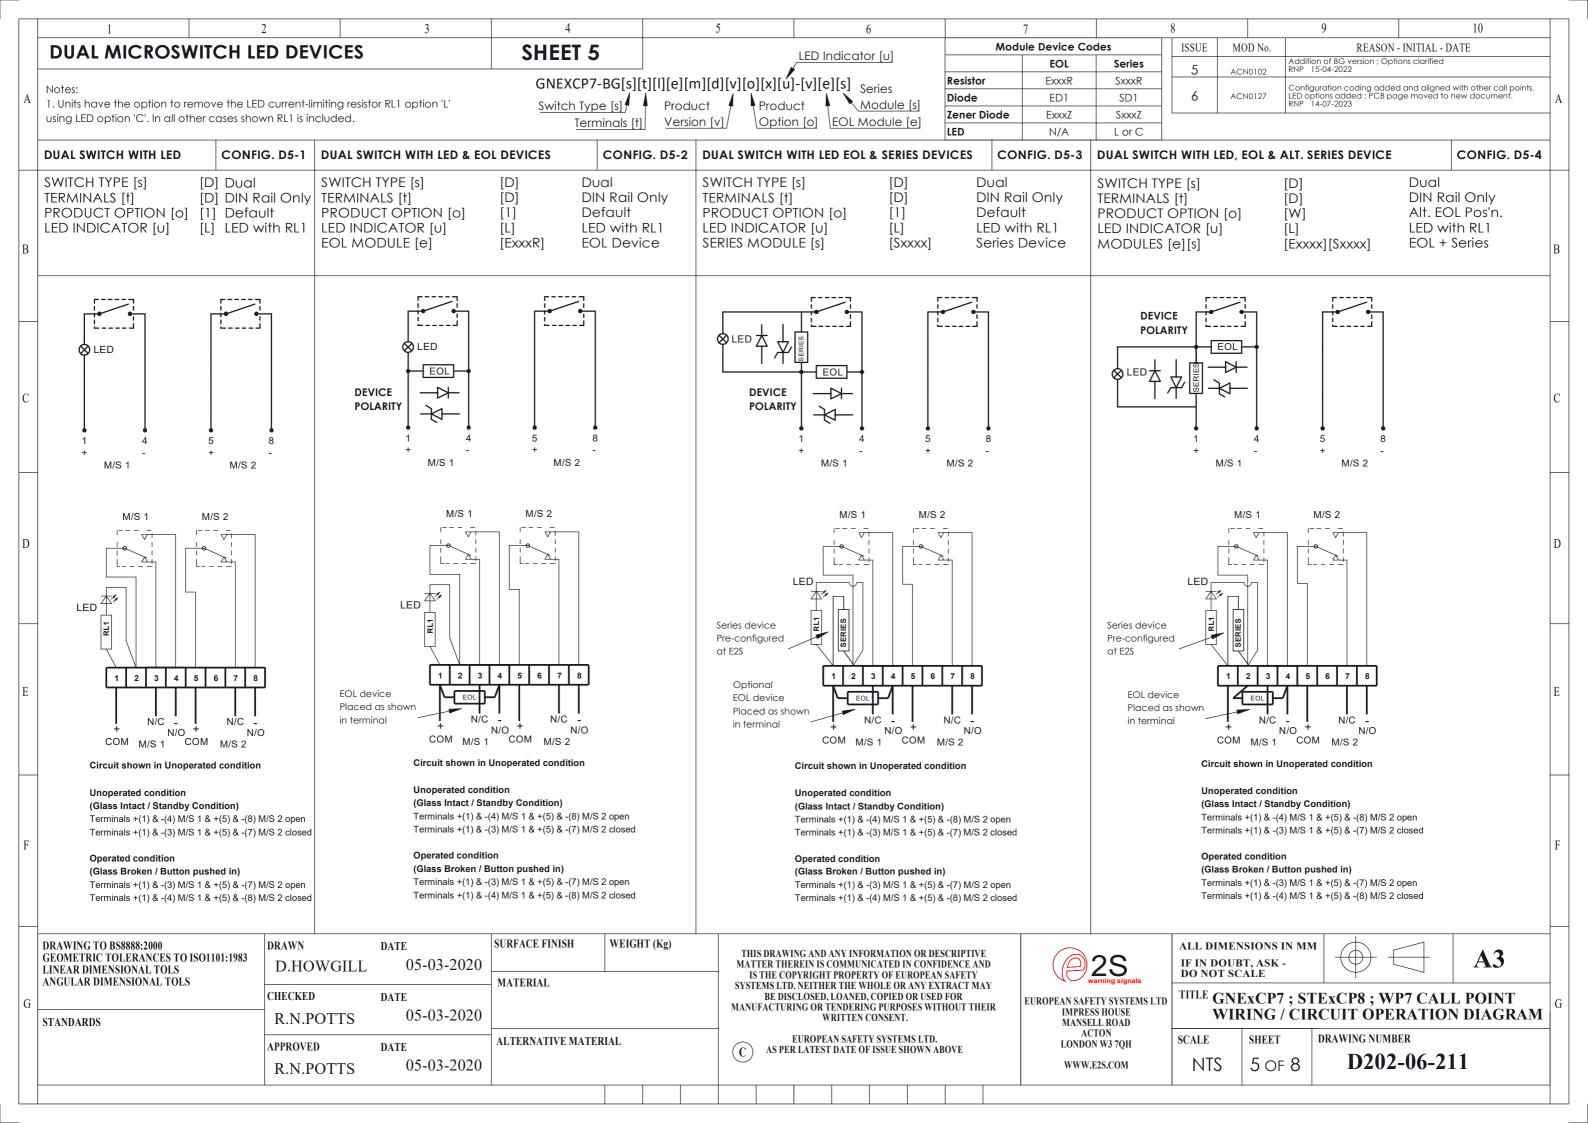


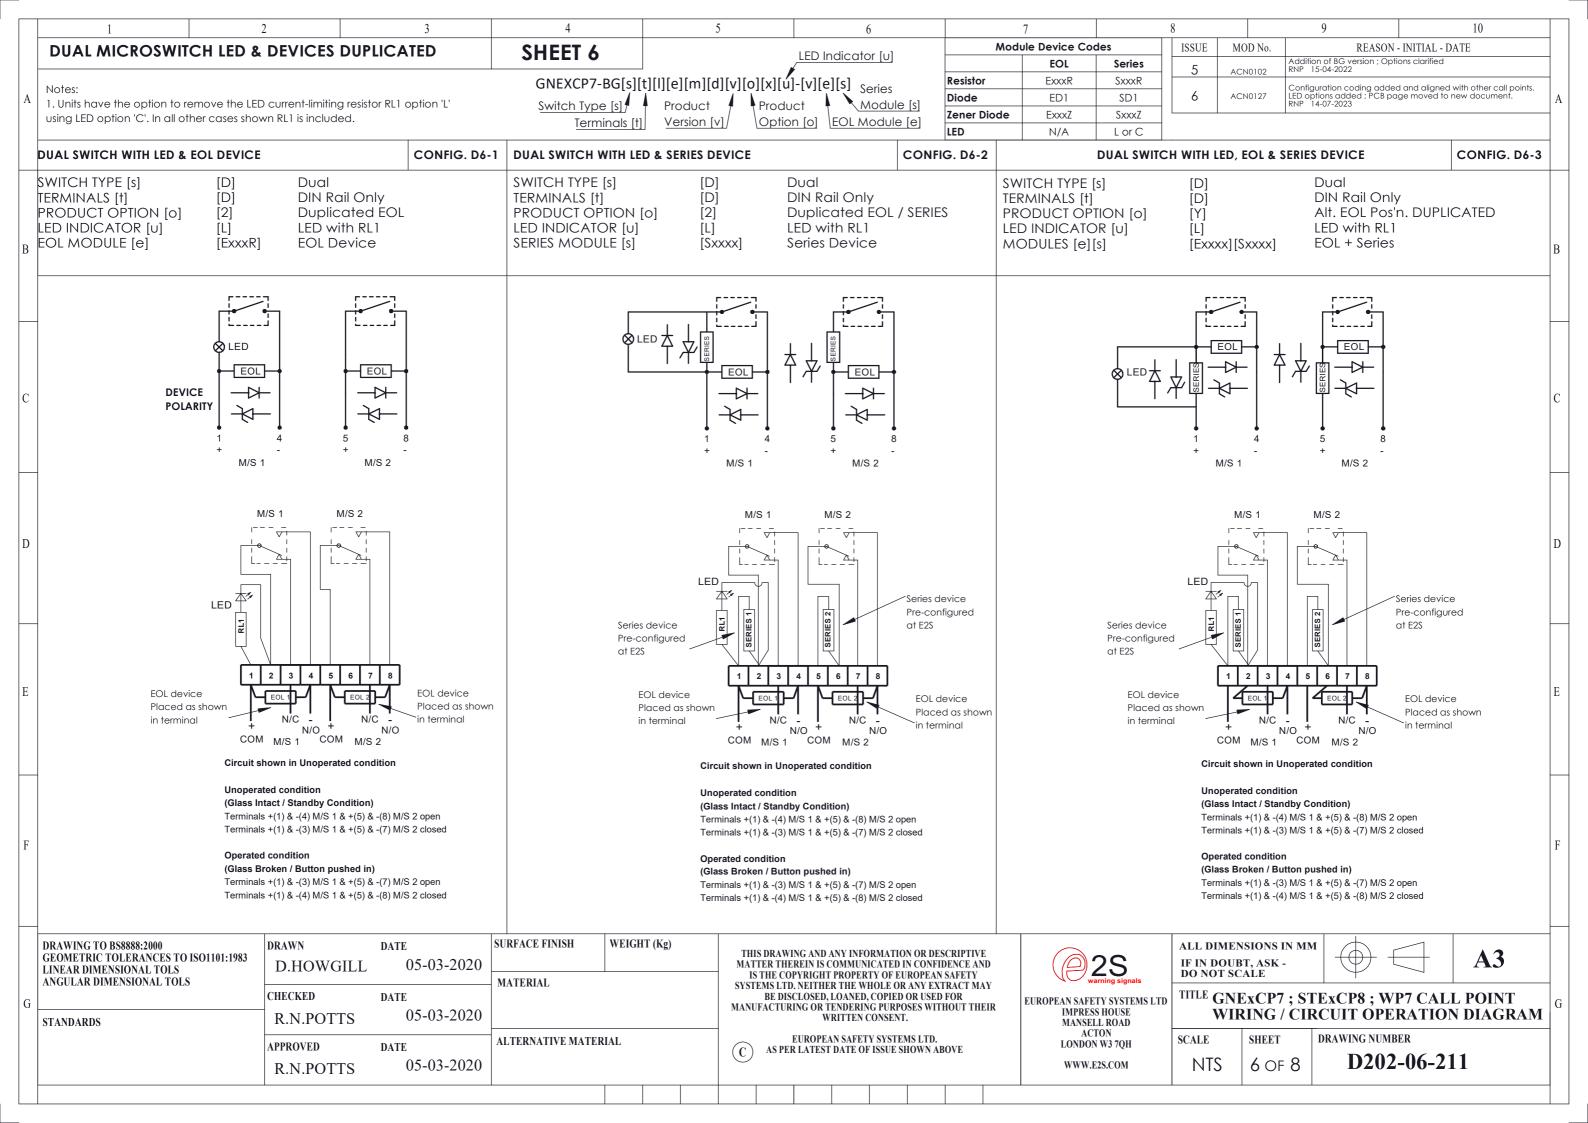


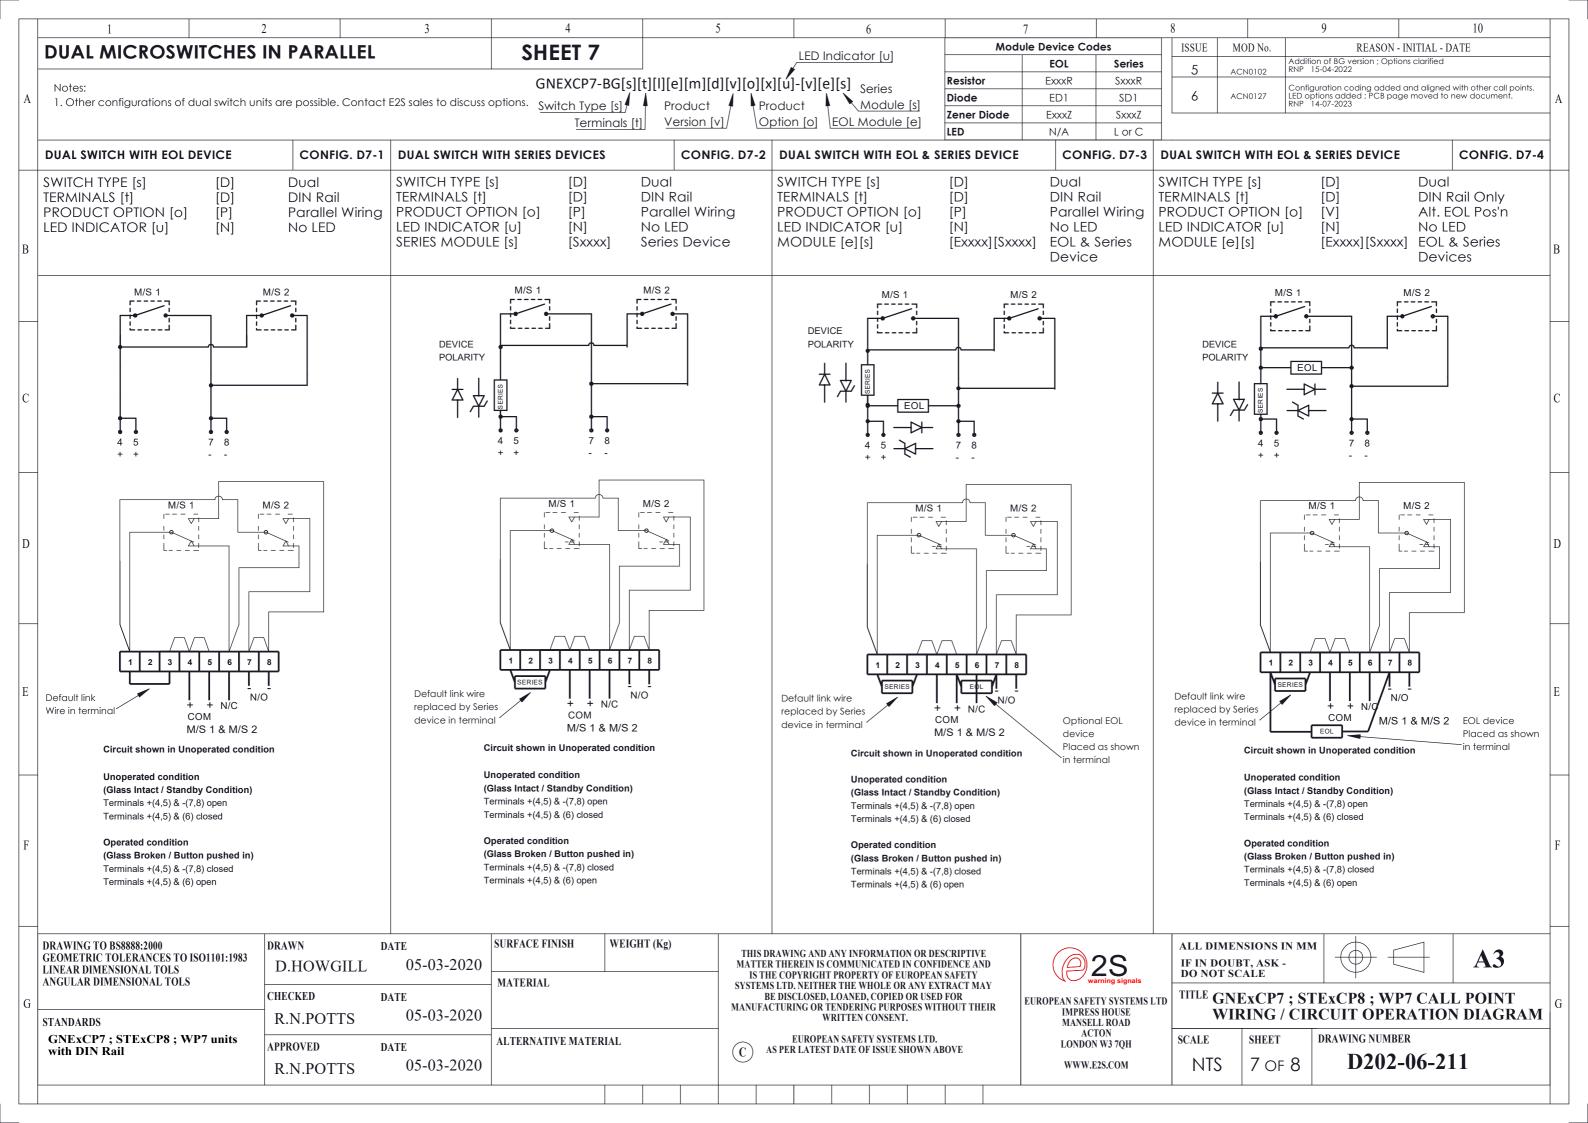


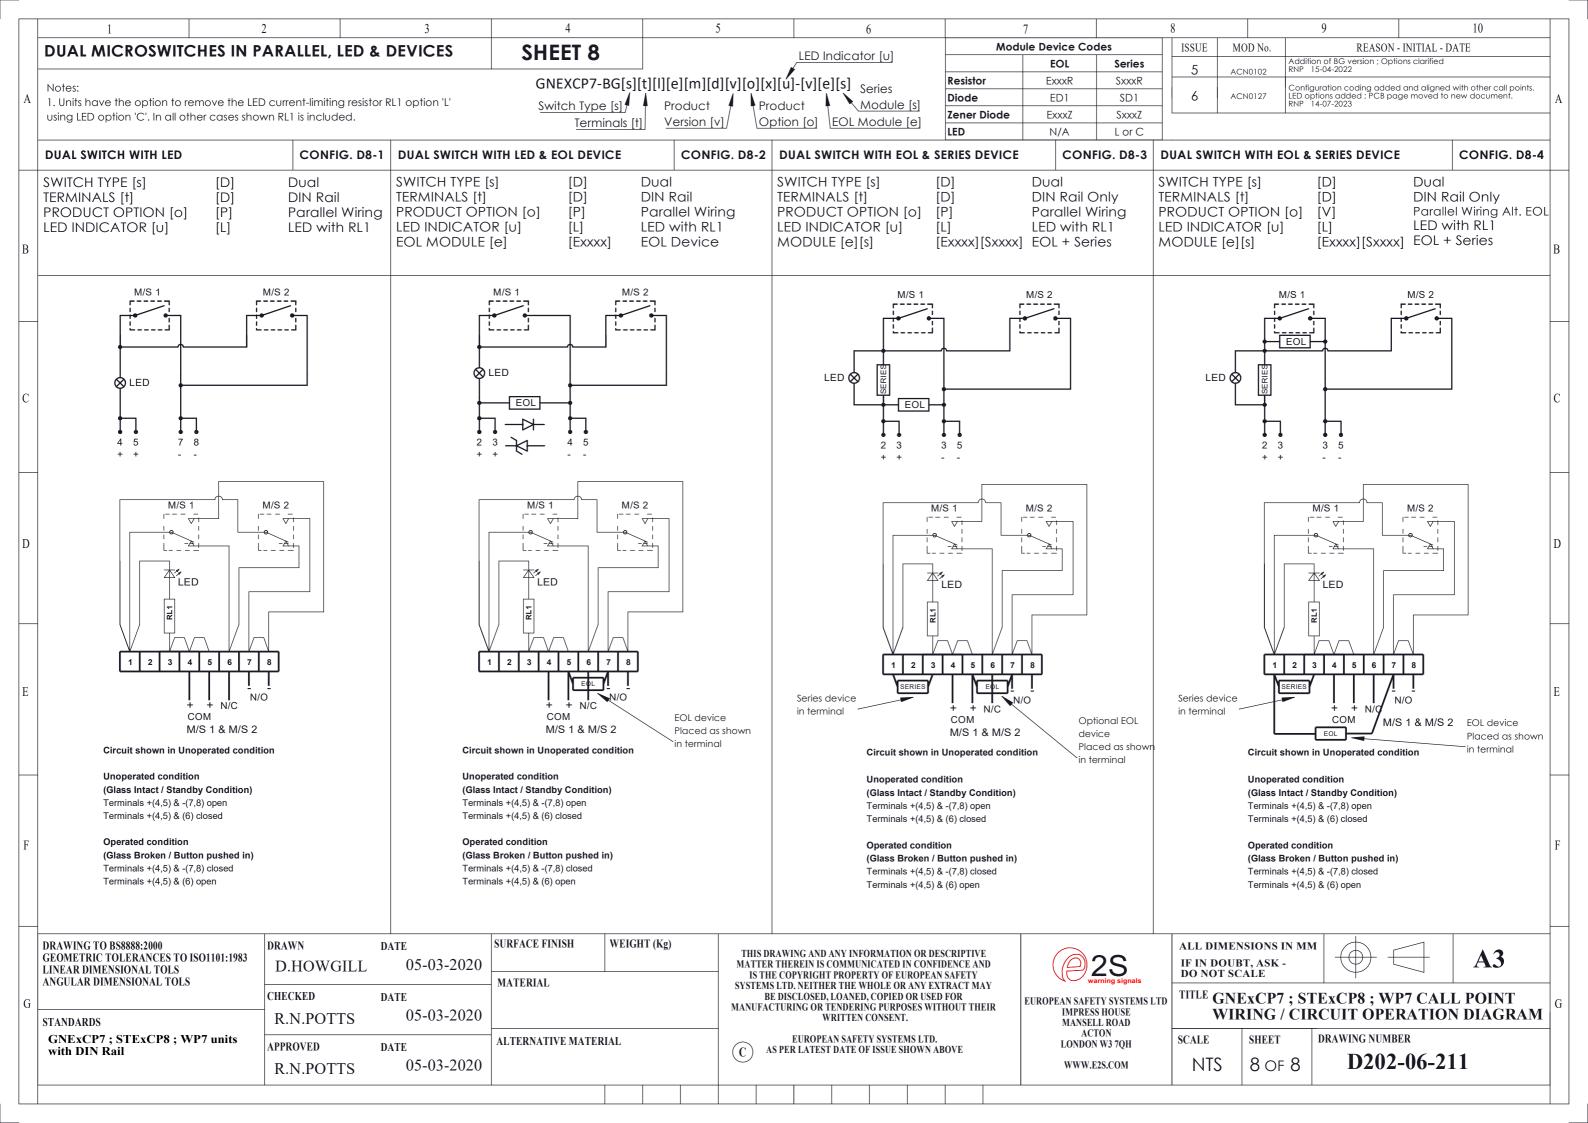


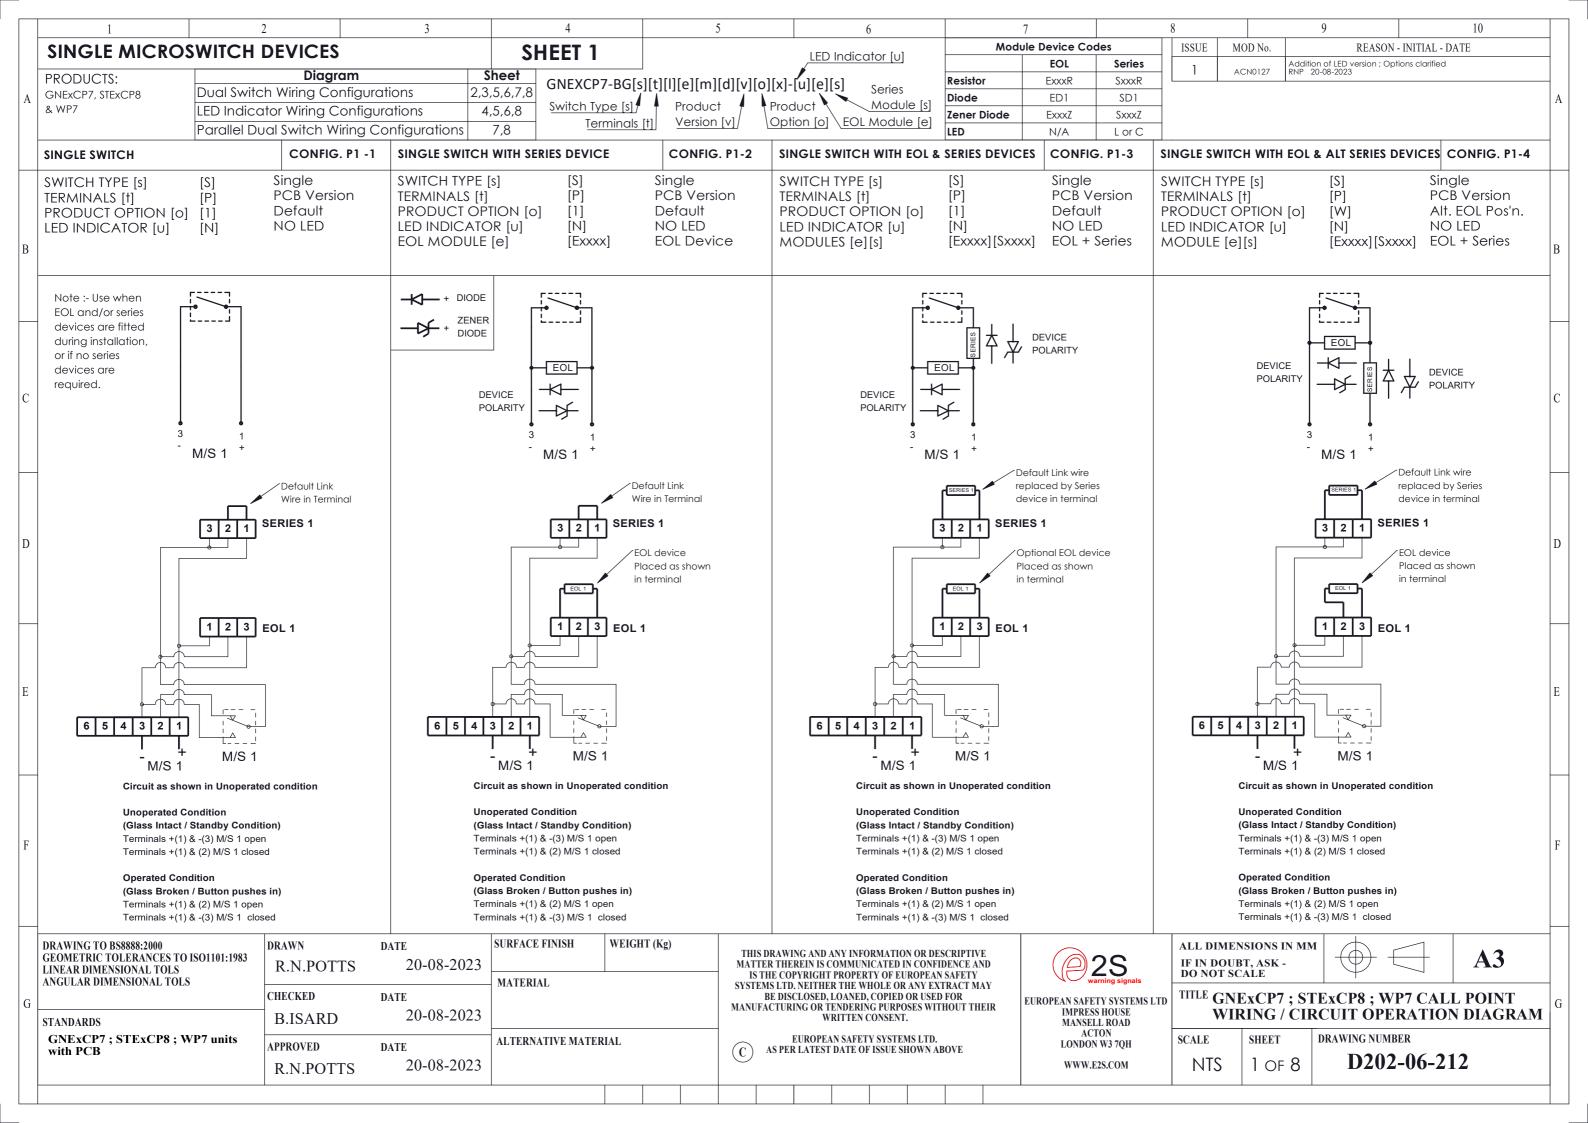


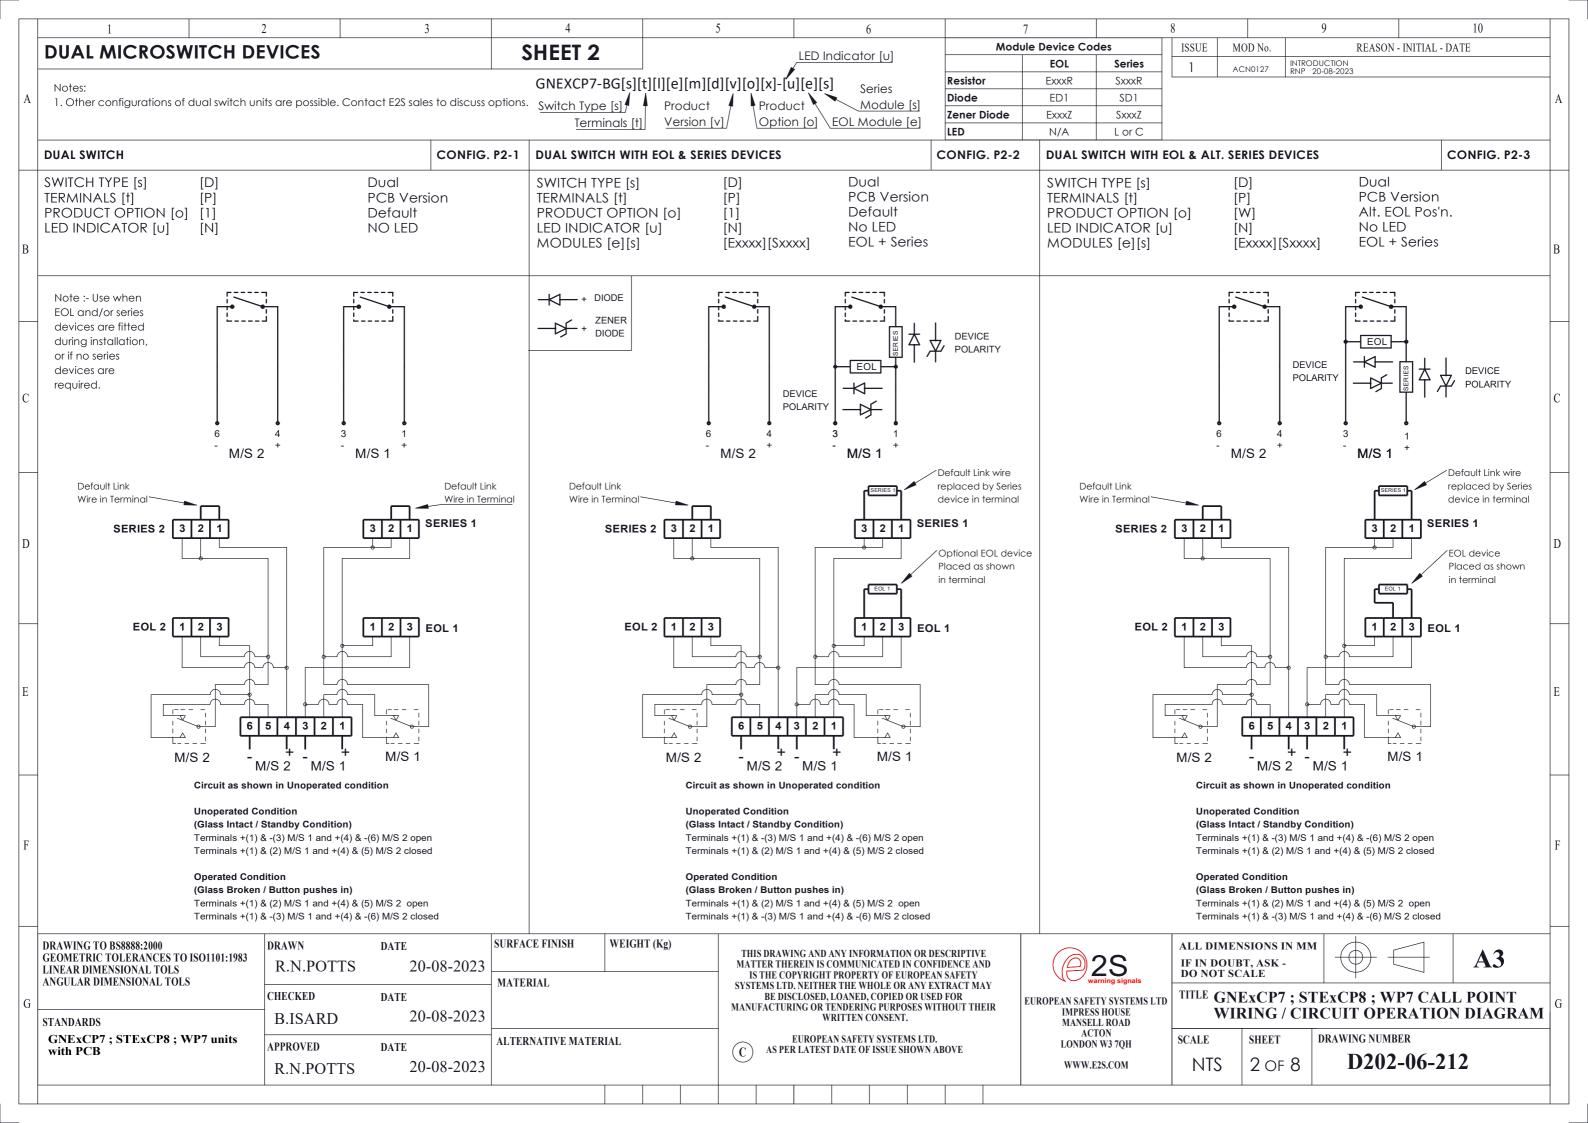


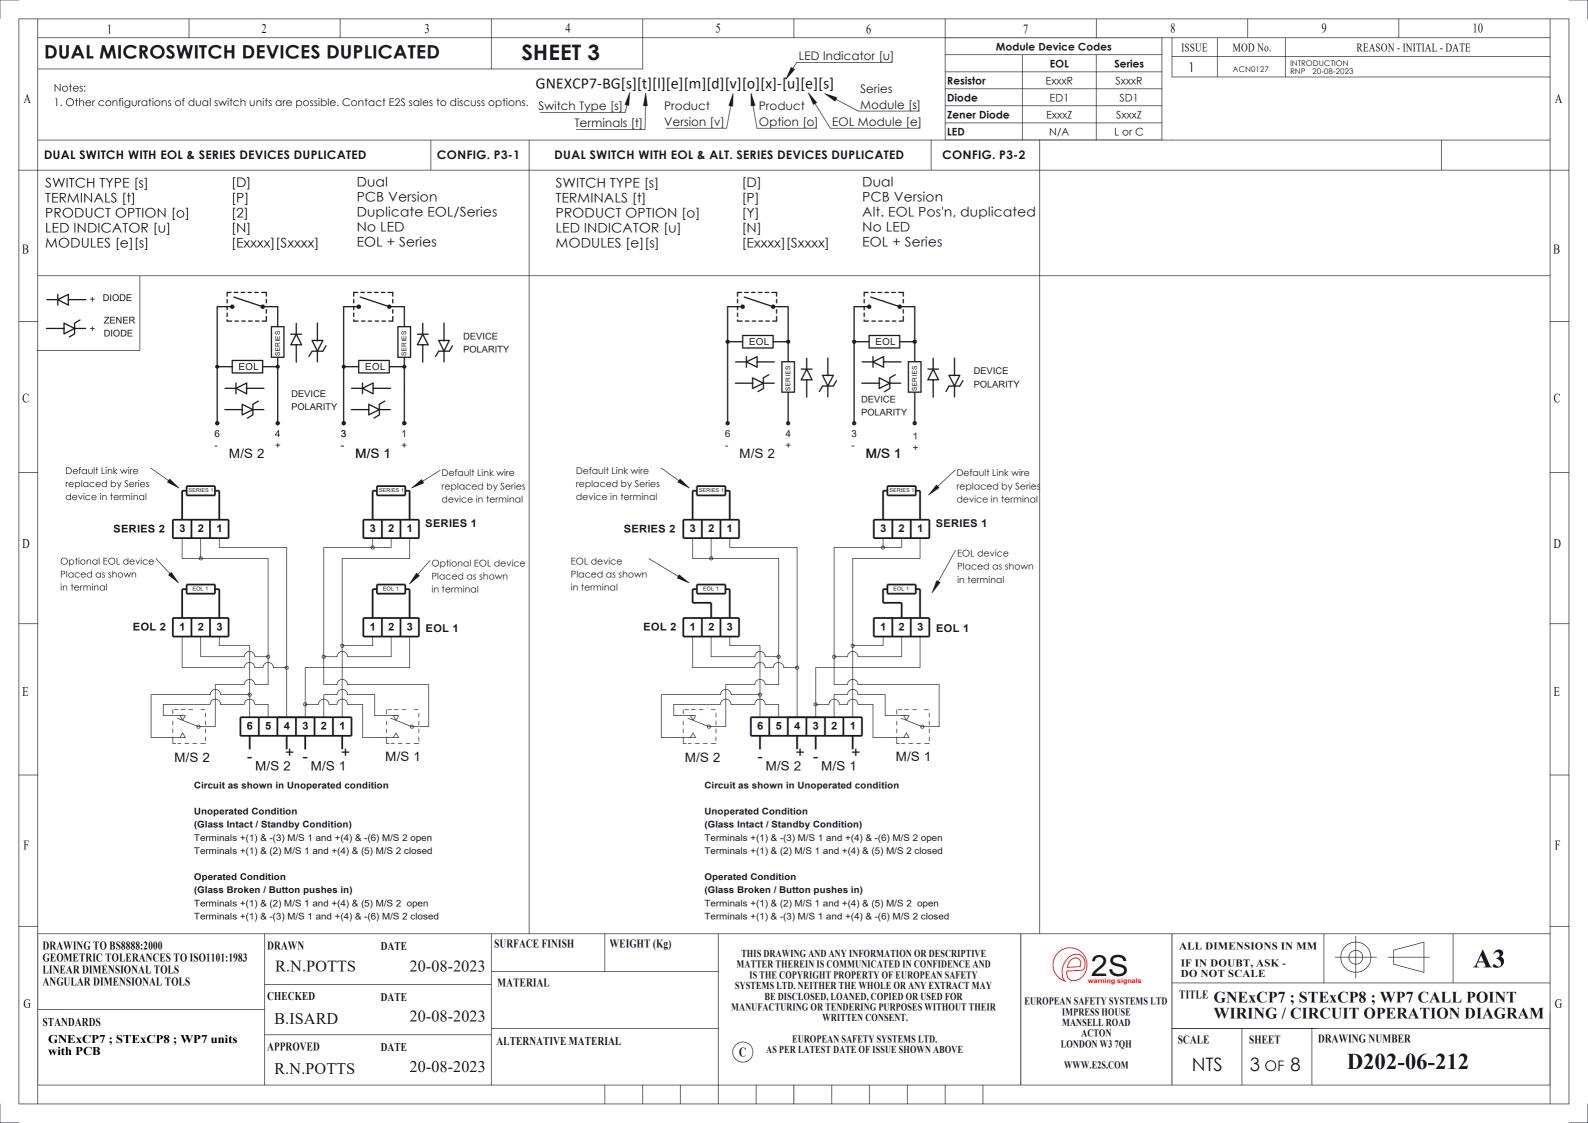


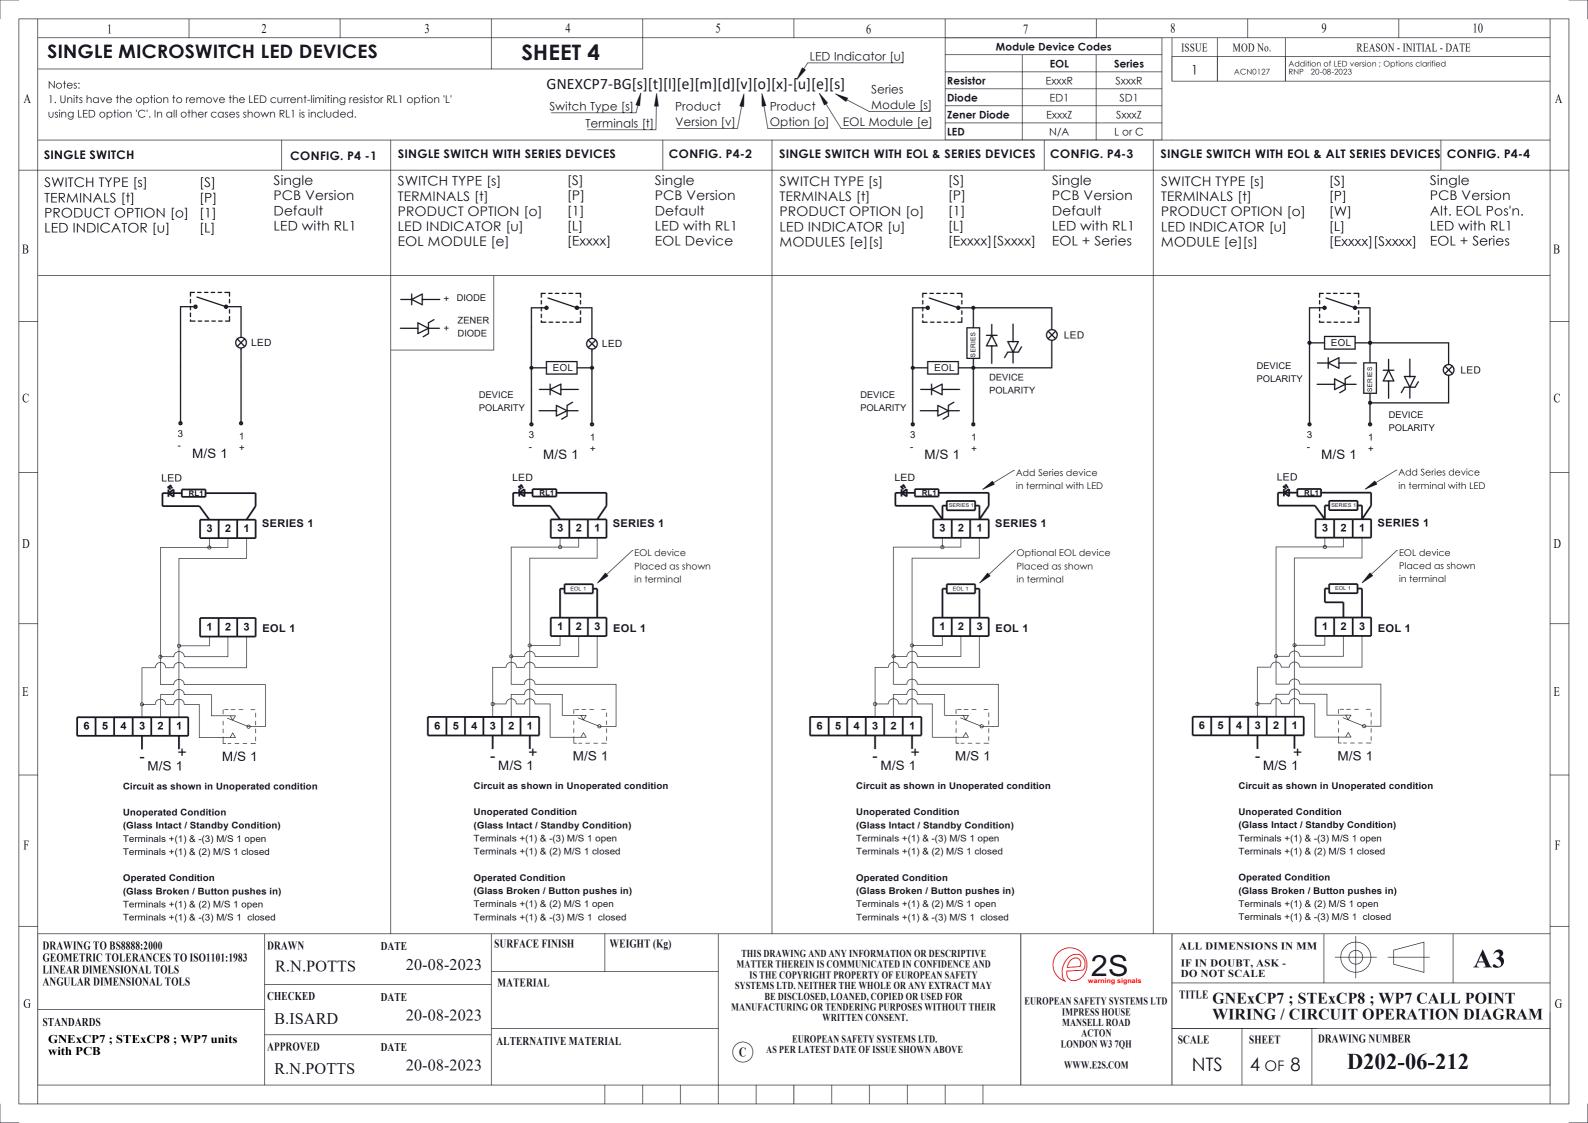

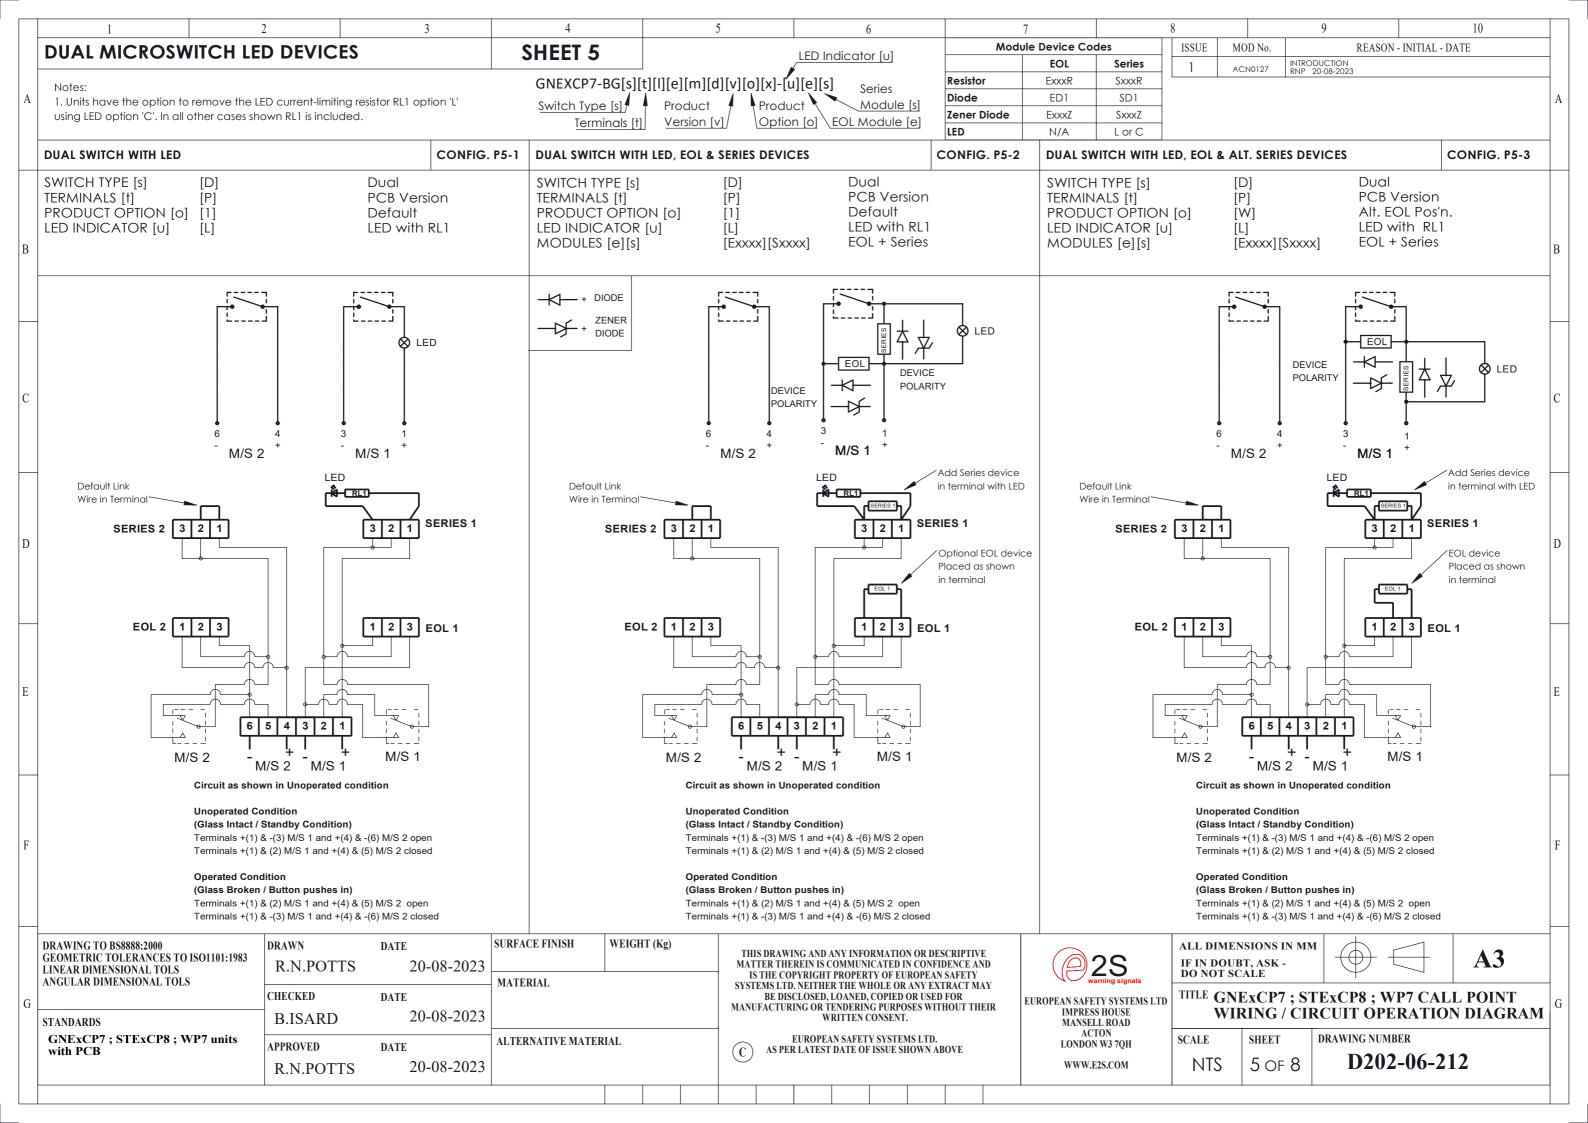

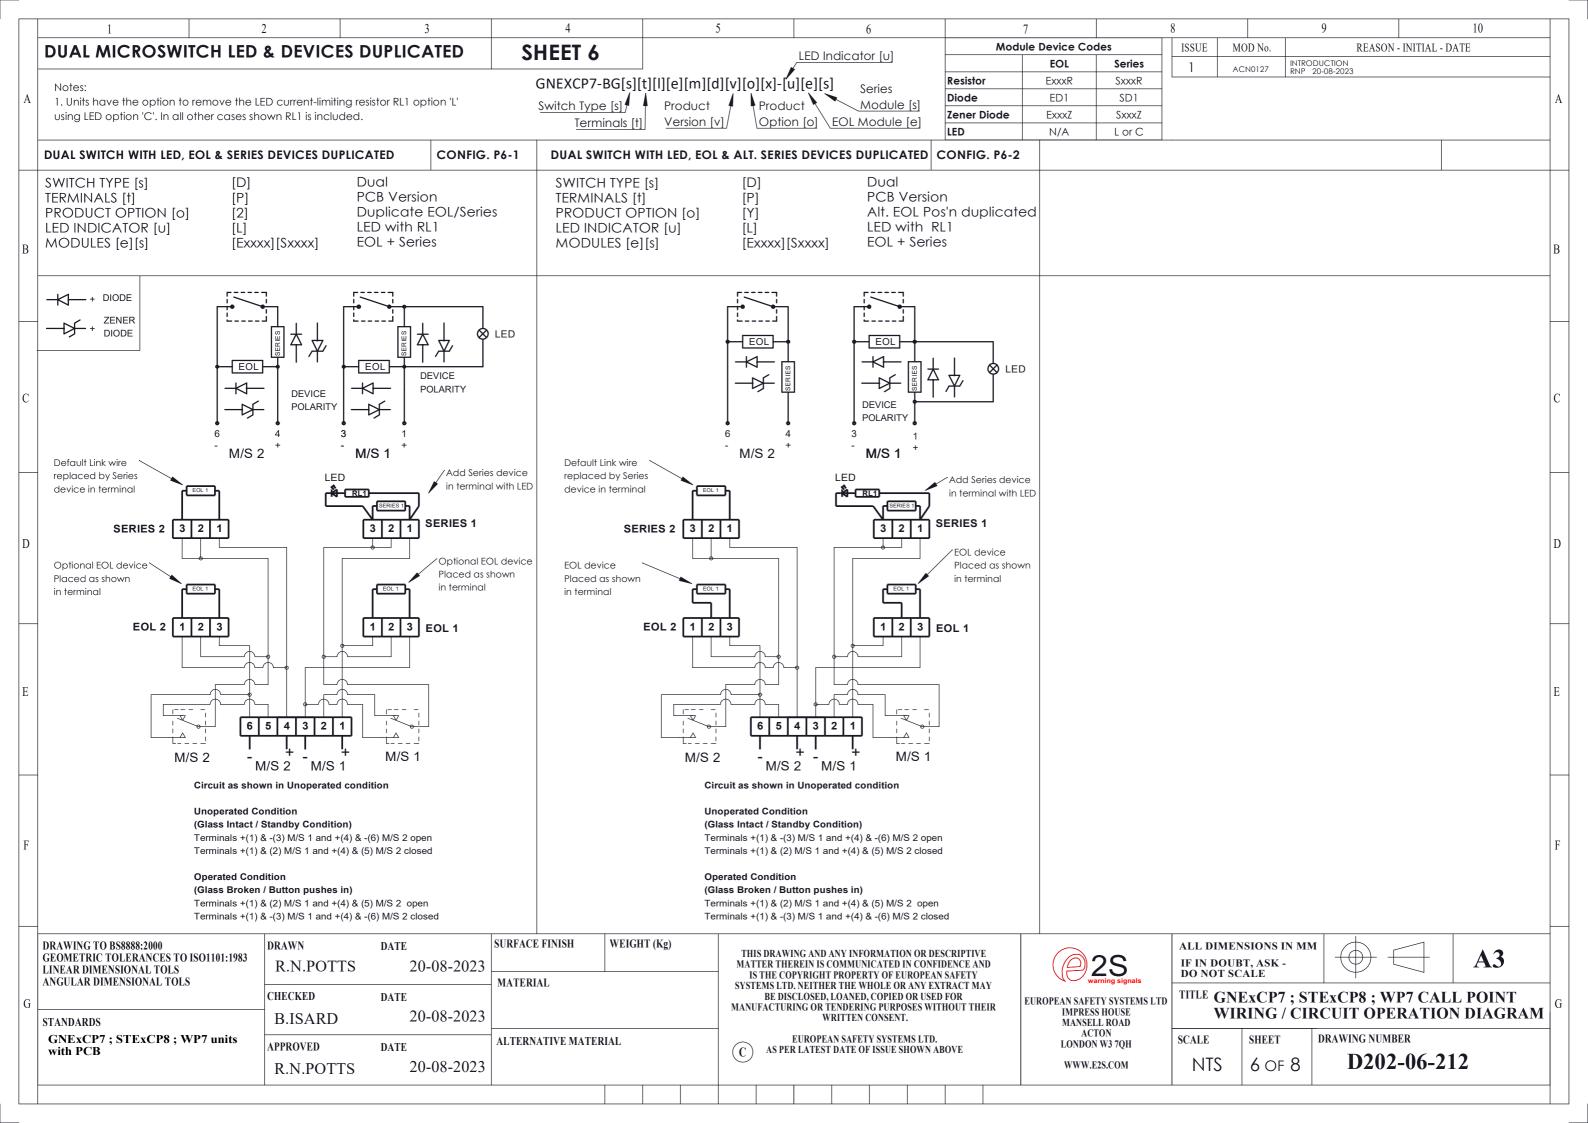

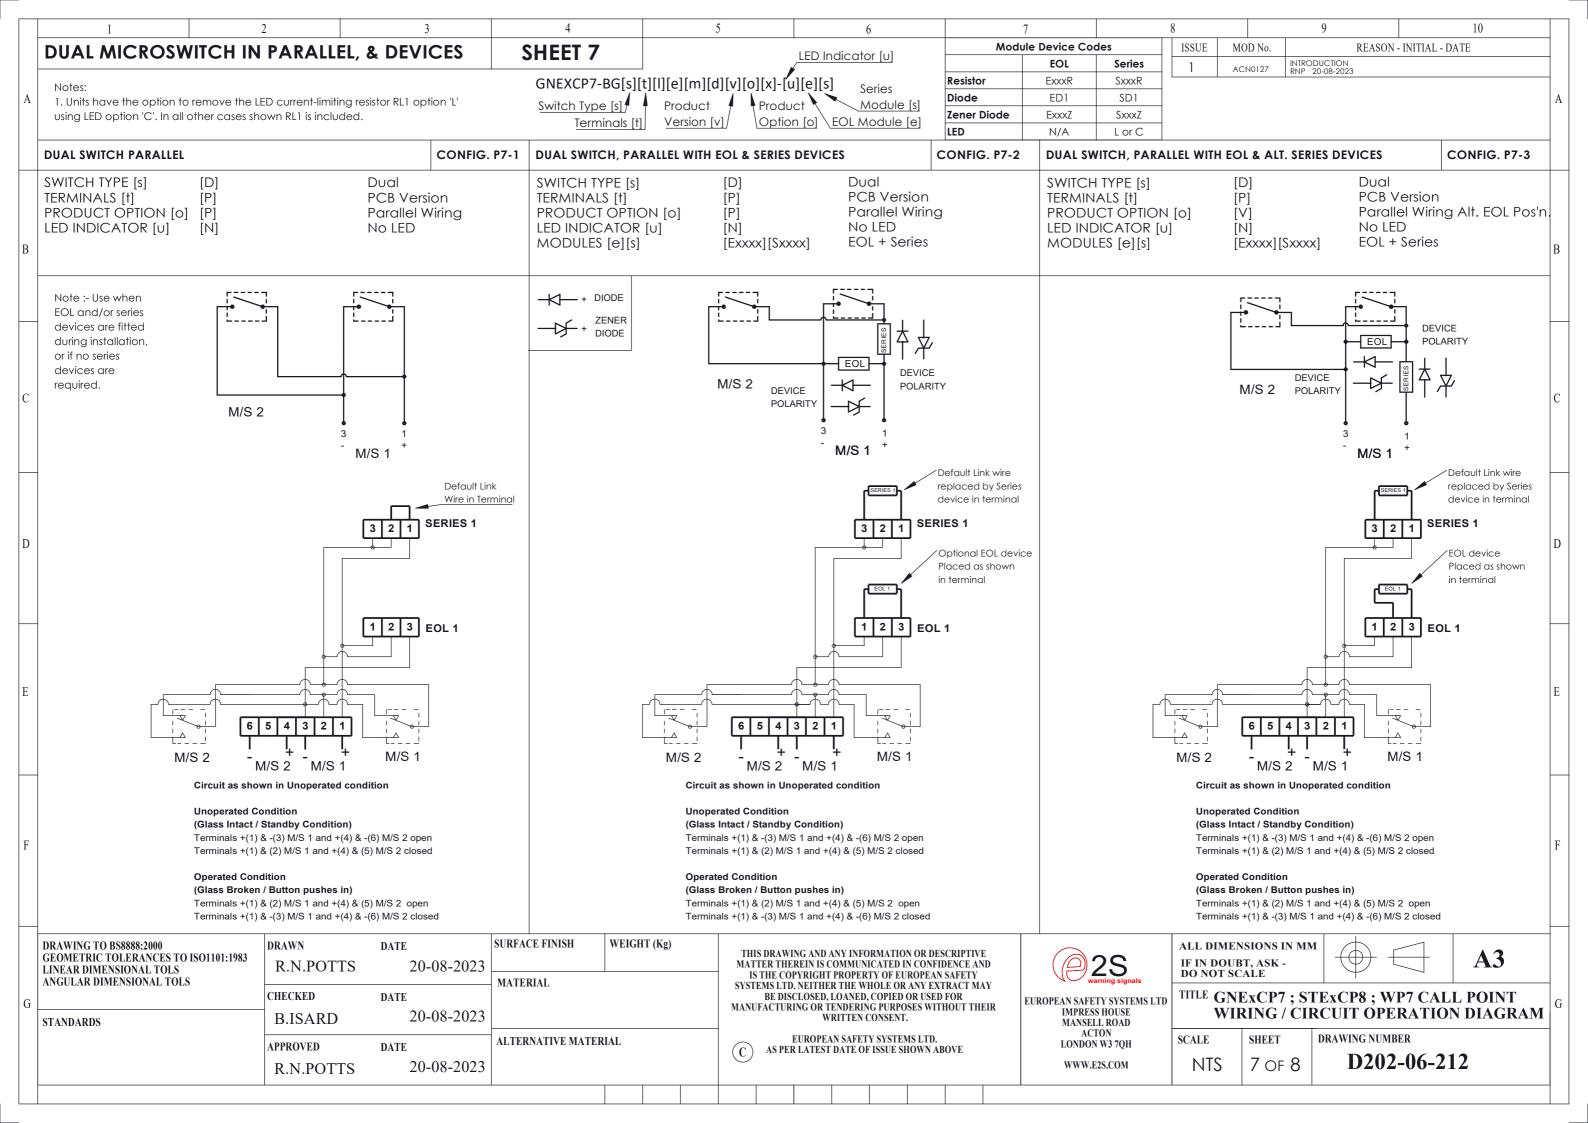

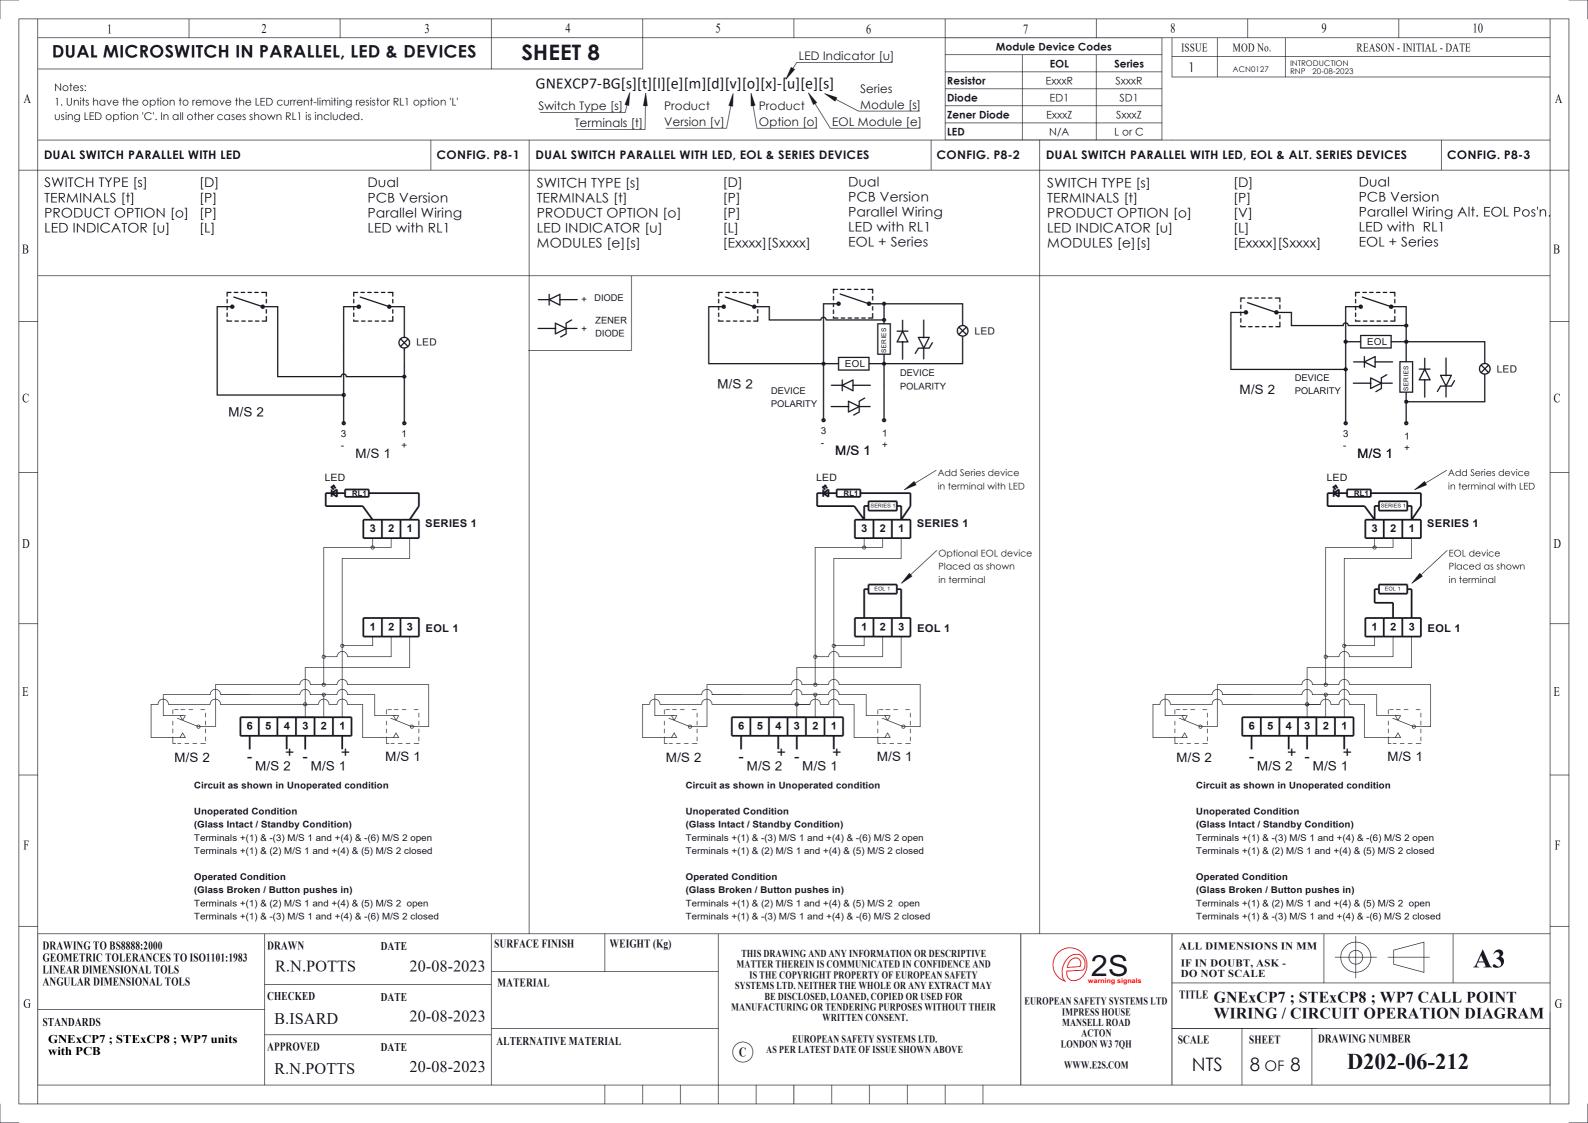

EU Declaration of Conformity



Manufacturer: European Safety Systems Ltd.

Impress House, Mansell Road, Acton

London, W3 7QH United Kingdom

Authorised Representative: E2S Warnsignaltechnik UG

Charlottenstrasse 45-51

72764 Reutlingen

Germany

Equipment Type: GNExCP7-BG-S, GNExCP7-BG-D, GNExCP7-BG-S-L or C, GNExCP7-BG-D-L or C

GNExCP7-PB-S, GNExCP7-PM-S, GNExCP7-PT-S,

GNExCP7-PB-S-L or C, GNExCP7-PM-S-L or C, GNExCP7-PT-S-L or C,

GNExCP7-PB-D, GNExCP7-PM-D, GNExCP7-PT-D

GNExCP7-PB-D-L or C, GNExCP7-PM-D-L or C, GNExCP7-PT-D-L or C

Directive 2014/34/EU: Equipment and Protective Systems for use in Potentially Explosive Atmospheres (ATEX)

Notified Body for EU type Examination (Module B): UL International Demko A/S

Notified Body No.: 0539

Sira Certification Service

Borupvang 5A, 2750 Ballerup, Denmark

EU-type Examination Certificate (Module B): DEMKO 19 ATEX 2101X

Notified Body for Quality Assurance Notification / Conformity to EU-type

hased on

quality assurance of the production process (Module D):

Notified Body No.: 2813 CSA Group Netherlands B.V, Utrechtseweg 310, 6812 AR, Arnhem, Netherlands

Quality Assurance Notification (Module D): SIRA 05 ATEX M342

Provisions fulfilled by the equipment: II 2G Ex d IIC T6...T4 Gb

II 2D Ex tb IIIC T100°C....T80°C Db

Standards applied: EN 60079-0:2018 EN 60079-1:2014

EN 60079-31:2014

IP6X Dust Protection to EN60079-0 / EN60079-31

Directive 2014/30/EU: Electromagnetic Compatibility Directive (EMC)

Standards applied: EN 61000-6-1:2007

EN 61000-6-2:2005

EN 61000-6-3:2007 / A1:2011 / AC: 2012

EN 61000-6-4:2007 / A1: 2011

Directive 2011/65/EU: Restriction of the use of certain hazardous substances in electrical and electronic equipment (ROHS)

The product and all the components contained within it are in accordance with the restriction of the use of hazardous substances in electrical and electronic equipment, including amendment by Directive 2015/863/EU.

Regulation (EC) 1907/2006: Registration, Evaluation, Authorisation and Restriction of Chemicals (REACH)

The product and all the components contained within it are free from substances of very high concern.

Other Standards and Regulations

EN 60529:1991 + A1:2000 + A2:2013. - Degrees of protection provided by enclosures (IP code) - enclosure rated IP66/67/68

Martin Streetz Document No.: DC-078_Issue_F
Quality Assurance Manager Date and Place of Issue: London, 14/09/2023

E2S Telephone: +44 (0)20 8743 8880 Fax: +44 (0)20 8740 4200 Email: sales@e2s.com www.e2s.com DC-078_lssue_F - Page 1 of 2 - QAF_252_lssue_5

EU Declaration of Conformity



On behalf of European Safety Systems Ltd., I declare that, on the date the equipment accompanied by this declaration is placed on the market, the equipment conforms with all technical and regulatory requirements of the above listed directives, regulations and standards.

This Declaration is issued under the sole responsibility of the manufacturer.

Martin Streetz Quality Assurance Manager

Document No.:
Date and Place of Issue:

DC-078_Issue_F London, 14/09/2023

E2S Telephone: +44 (0)20 8743 8880 Fax: +44 (0)20 8740 4200 Email: sales@e2s.com www.e2s.com

DC-078_Issue_F - Page 2 of 2 - QAF_252_Issue_5



UKCA Declaration of Conformity



Manufacturer: European Safety Systems Ltd.

Impress House, Mansell Road, Acton

London, W3 7QH United Kingdom

Equipment Type: GNExCP7-BG-S, GNExCP7-BG-D, GNExCP7-BG-S-L or C, GNExCP7-BG-D-L or C

GNExCP7-PB-S, GNExCP7-PM-S, GNExCP7-PT-S,

GNExCP7-PB-S-L or C, GNExCP7-PM-S-L or C, GNExCP7-PT-S-L or C,

GNExCP7-PB-D, GNExCP7-PM-D, GNExCP7-PT-D

GNExCP7-PB-D-L or C, GNExCP7-PM-D-L or C, GNExCP7-PT-D-L or C

Directive UKSI 2016:1107 (as amended by UKSI 2019:696) – Schedule 3A, Part 1: Product or Protective System Intended for use in Potentially Explosive Atmospheres

(UKCA)

Notified Body for UK type Examination (Module B): UL International (UK) Ltd

Notified Body No.: 0843

Unit 1-3 Horizon Kingsland Business Park, Wade Road,

Basingstoke, Hampshire RG24 8AH UK

UK-type Examination Certificate (Module B): UL21UKEX2134X

Notified Body for Quality Assurance Notification / Conformity to EU-type

based on quality assurance of the production process (Module D):

Sira Certification Service Notified Body No.: 0518

Rake Lane, Eccleston, Chester CH4 9JN, UK

Quality Assurance Notification (Module D): CSAE 22UKQAN0046

Provisions fulfilled by the equipment: II 2G Ex d IIC T6...T4 Gb

II 2D Ex tb IIIC T100°C... T80°C Db

Standards applied: EN 60079-0:2018

EN 60079-1:2014 EN 60079-31:2014

IP6X Dust Protection to EN60079-0 / EN60079-31

Directive 2014/30/EU: Electromagnetic Compatibility Directive (EMC)

Standards applied: EN 61000-6-1:2007

EN 61000-6-2:2005

EN 61000-6-3:2007 / A1:2011 / AC: 2012

EN 61000-6-4:2007 / A1: 2011

Directive 2011/65/EU: Restriction of the use of certain hazardous substances in electrical and electronic equipment (ROHS)

The product and all the components contained within it are in accordance with the restriction of the use of hazardous substances in electrical and electronic equipment, including amendment by Directive 2015/863/EU.

Regulation (EC) 1907/2006: Registration, Evaluation, Authorisation and Restriction of Chemicals (REACH)

The product and all the components contained within it are free from substances of very high concern.

Other Standards and Regulations

EN 60529:1991 + A1:2000 + A2:2013. - Degrees of protection provided by enclosures (IP code) - enclosure rated IP66/67/68

On behalf of European Safety Systems Ltd., I declare that, on the date the equipment accompanied by this declaration is placed on the market, the equipment conforms with all technical and regulatory requirements of the above listed directives, regulations and standards.

This Declaration is issued under the sole responsibility of the manufacturer.

Martin Streetz Document No.: DC-099_Issue_B
Quality Assurance Manager Date and Place of Issue: London, 14/09/2023

E2S Telephone: +44 (0)20 8743 8880 Fax: +44 (0)20 8740 4200 Email: sales@e2s.com www.e2s.com DC-099_lssue_B - Page 1 of 1 - QAF_252_lssue_5